



# Magnolia Plus Series

GEO THERMAL HEAT PUMPS

2 TO 6 TONS

Submittal Data  
English Language  
IP/Metric Units  
SD2300AG 06/21

**GEOSTAR**


Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## Model Nomenclature

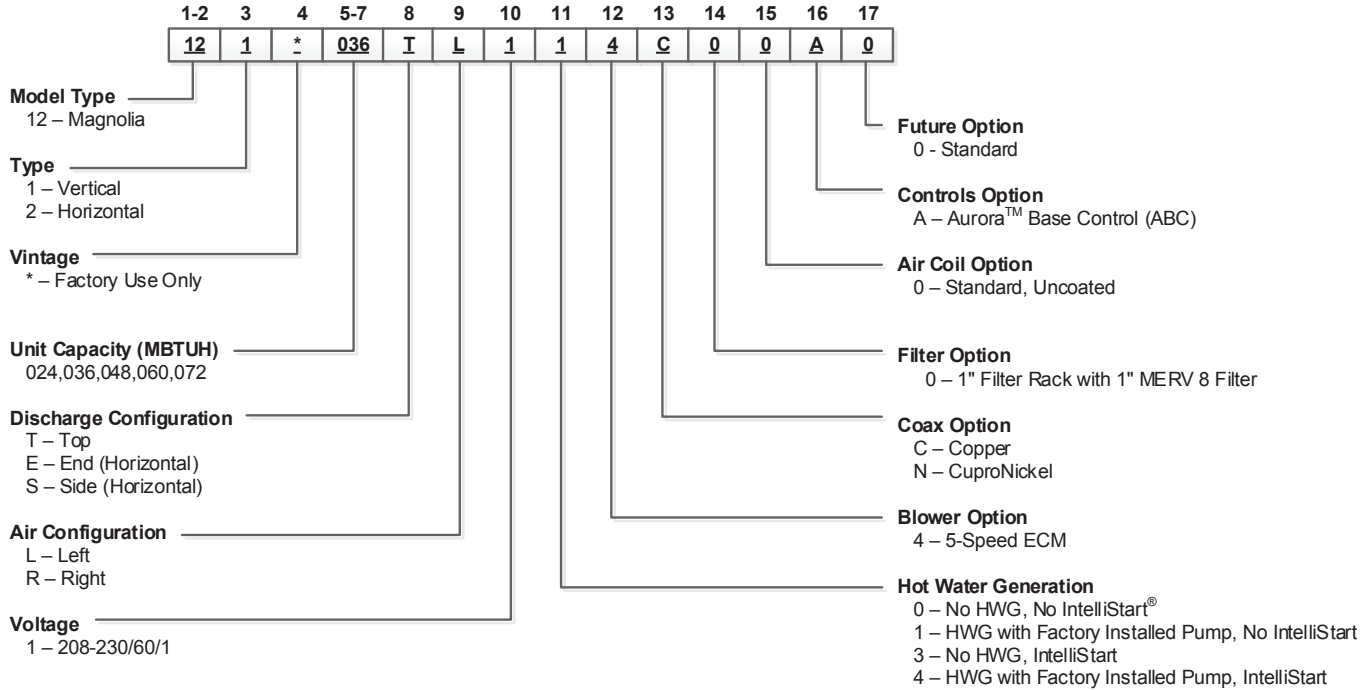

Rev.: 04/28/2021

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## AHRI/ISO 13256-1 Performance Ratings cont.

**5 Speed ECM motor**  
**AHRI/ASHRAE/ISO 13256-1**  
**English (IP) Units**

Model	Capacity Modulation	Flow Rate		Water Loop Heat Pump				Ground Water Heat Pump				Ground Loop Heat Pump			
				Cooling EWT 86°F		Heating EWT 68°F		Cooling EWT 59°F		Heating EWT 50°F		Cooling Brine Full Load 77°F Part Load 68°F		Heating Brine Full Load 32°F Part Load 41°F	
		gpm	cfm	Capacity Btuh	EER Btuh/W	Capacity Btuh	COP	Capacity Btuh	EER Btuh/W	Capacity Btuh	COP	Capacity Btuh	EER Btuh/W	Capacity Btuh	COP
024	Full	8	800	22,000	13.9	28,300	4.9	25,100	20.6	23,500	4.4	23,100	15.6	18,900	3.8
	Part	7	600	16,300	14.7	20,800	5.3	18,800	24.4	17,000	4.5	18,200	20.6	14,900	4.1
036	Full	9	1200	33,700	13.5	42,500	4.7	38,000	19.7	35,500	4.2	35,100	15.5	26,000	3.6
	Part	8	1000	25,300	15.4	30,500	5.3	28,900	25.5	25,200	4.5	27,600	21.5	21,000	4.1
048	Full	12	1600	46,500	14.8	53,900	4.8	52,300	21.8	45,000	4.3	49,000	16.1	36,000	3.7
	Part	11	1400	34,800	16.5	39,700	5.4	39,800	27.3	32,800	4.5	38,200	22.1	28,500	4.1
060	Full	16	1800	57,200	14.3	69,000	4.5	64,100	20.7	56,500	4.0	59,900	16.5	45,300	3.4
	Part	14	1500	43,000	15.9	51,000	4.9	49,100	26.2	42,400	4.2	47,200	22.3	36,000	3.9
072	Full	18	1900	64,400	14.4	82,800	4.5	71,800	20.8	68,500	4.1	67,000	16.4	52,000	3.5
	Part	16	1550	50,400	15.7	63,600	4.8	56,800	25.3	52,800	4.1	54,200	21.9	42,500	3.7

Cooling capacities based upon 80.6°F DB, 66.2°F WB entering air temperature

Heating capacities based upon 68°F DB, 59°F WB entering air temperature

All ratings based upon 208V operation

3/24/17

**5 Speed ECM motor**  
**ARI/ASHRAE/ISO 13256-1**  
**Metric (SI) Units**

Model	Capacity Modulation	Flow Rate		Water Loop Heat Pump				Ground Water Heat Pump				Ground Loop Heat Pump			
				Cooling EWT 30°C		Heating EWT 20°C		Cooling EWT 15°C		Heating EWT 10°C		Cooling Brine Full Load 25°C Part Load 20°C		Heating Brine Full Load 0°C Part Load 5°C	
		water L/S	air L/S	Capacity Watts	EER (W/W)	Capacity Watts	COP	Capacity Watts	EER (W/W)	Capacity Watts	COP	Capacity Watts	EER (W/W)	Capacity Watts	COP
024	Full	0.5	377.6	6,448	4.1	8,294	4.9	7,356	6.0	6,887	4.4	6,770	4.6	5,539	3.8
	Part	0.4	283.2	4,777	4.3	6,096	5.3	5,510	7.2	4,982	4.5	5,334	6.0	4,367	4.1
036	Full	0.6	566.4	9,877	4.0	12,456	4.7	11,137	5.8	10,404	4.2	10,287	4.5	7,620	3.6
	Part	0.5	472.0	7,415	4.5	8,939	5.3	8,470	7.5	7,386	4.5	8,089	6.3	6,155	4.1
048	Full	0.8	755.2	13,628	4.3	15,797	4.8	15,328	6.4	13,189	4.3	14,361	4.7	10,551	3.7
	Part	0.7	660.8	10,199	4.8	11,635	5.4	11,665	8.0	9,613	4.5	11,196	6.5	8,353	4.1
060	Full	1.0	849.6	16,764	4.2	20,223	4.5	18,787	6.1	16,559	4.0	17,556	4.8	13,277	3.4
	Part	0.9	708.0	12,603	4.7	14,947	4.9	14,390	7.7	12,427	4.2	13,834	6.5	10,551	3.9
072	Full	1.1	896.8	18,875	4.2	24,267	4.5	21,043	6.1	20,076	4.1	19,637	4.8	15,240	3.5
	Part	1.0	731.6	14,771	4.6	18,640	4.8	16,647	7.4	15,475	4.1	15,885	6.4	12,456	3.7

Cooling capacities based upon 27°C DB, 19°C WB entering air temperature

Heating capacities based upon 20°C DB, 15°C WB entering air temperature

All ratings based upon 208V operation

cfm\*0.472 = l/s

gpm\*0.0631 = l/s

in wg\*249 = pascals

ft of hd \*2990 = pascals

3/24/17

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## AHRI/ISO 13256-1 Performance Ratings cont.

### Energy Star Compliance Table

Model	Tier 3	
	Ground Water	Ground Loop
024	Yes	Yes
036	Yes	Yes
048	Yes	Yes
060	Yes	Yes
072	Yes	Yes

12/14/2016

### Energy Star Rating Criteria

In order for water-source heat pumps to be Energy Star rated they must meet or exceed the minimum efficiency requirements listed below. Tier 3 represents the current minimum efficiency water source heat pumps must have in order to be Energy Star rated.

### Tier 3: 1/1/2012 – No Effective End Date Published

<b>Water-to-Air</b>	<b>EER</b>	<b>COP</b>
Ground Loop	17.1	3.6
Ground Water	21.1	4.1
<b>Water-to-Water</b>		
Ground Loop	16.1	3.1
Ground Water	20.1	3.5




Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## Vertical Dimensional Data

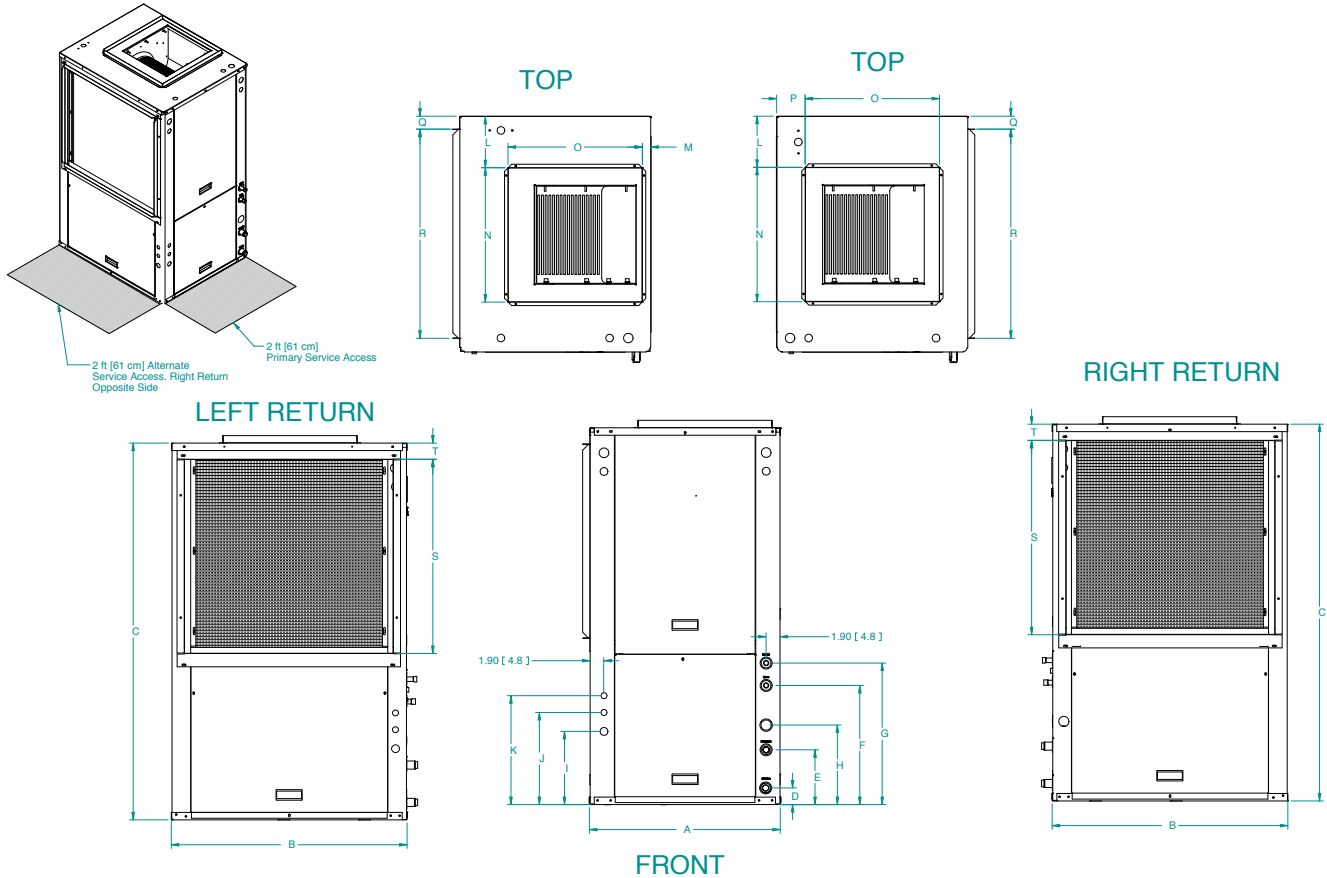

Vertical Top Flow Model	Overall Cabinet			Water Connections							Electrical Connections			Discharge Connection					Return Connection				
	A	B	C	D	E	F	G	H	Loop Water FPT	HWG Sweat (I.D.)	I	J	K	Duct Flange Installed					Return Duct Flanges				
											3/4" cond	1/2" cond	1/2" cond	L	M	N	O	P	Q	R	S	T	
	Width	Depth	Height	Loop In	Loop Out	HWG In	HWG Out	Condensate	Power Supply	Ext Pump	Low Voltage	Supply Width	Supply Depth	Return Depth	Return Height								
024	in.	22.5	26.5	39.4	2.3	5.3	13.4	16.4	9.6	1"	1/2" female	8.9	11.4	13.7	6.3	0.7	14.0	14.0	2.7	2.3	22.0	18.0	1.8
	cm.	57.2	67.3	100.1	5.8	13.5	34.0	41.7	24.4	Swivel	female	22.6	29.0	34.8	16.0	1.8	35.6	35.6	6.9	5.8	55.9	45.7	4.6
036	in.	22.5	26.5	44.5	2.0	7.0	13.5	16.5	10.2	1"	1/2" female	9.5	12.1	14.3	6.1	0.8	14.0	14.0	4.4	2.4	22.0	22.0	2.0
	cm.	57.2	67.3	113.0	5.1	17.8	34.3	41.9	25.9	Swivel	female	24.1	30.7	36.3	15.5	2.0	35.6	35.6	11.2	6.1	55.9	55.9	5.1
048-060	in.	25.6	31.6	50.4	2.3	7.3	15.9	18.9	10.6	1"	1/2" female	9.8	12.3	14.6	6.9	1.1	18.0	18.0	3.8	1.7	28.0	26.0	1.7
	cm.	65.0	80.3	128.0	5.8	18.5	40.4	48.0	26.9	Swivel	female	24.9	31.2	37.1	17.5	2.8	45.7	45.7	9.7	4.3	71.1	66.0	4.3
072	in.	25.6	31.6	54.4	2.3	7.3	15.9	18.9	10.6	1"	1/2" female	9.8	12.3	14.6	6.9	1.1	18.0	18.0	3.8	1.7	28.1	30.0	2.2
	cm.	65.0	80.3	138.2	5.8	18.5	40.4	48.0	26.9	Swivel	female	24.9	31.2	37.1	17.5	2.8	45.7	45.7	9.7	4.3	71.4	76.2	5.6

Condensate is 3/4" PVC female glue socket and is switchable from side to front

Unit shipped with 1" [25.4mm] return duct flanges and are suitable for duct connection.

Discharge flange is field installed and extends 1" [25.4mm] from cabinet

Water connections extend 1.2" [30.5mm] beyond front of cabinet.

The optional 1" filter rack (not shown) has the same return opening connection size as the duct flanges shown in the drawing. The filter rack extends 2.25"(57.1 mm) from the unit.

The optional 1" filter rack is suitable for duct connection.

The optional filter rails (not shown) extend 1.25" (31.75 mm) from cabinet.

7/17/14

©2014 The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products.


Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## Horizontal Dimensional Data

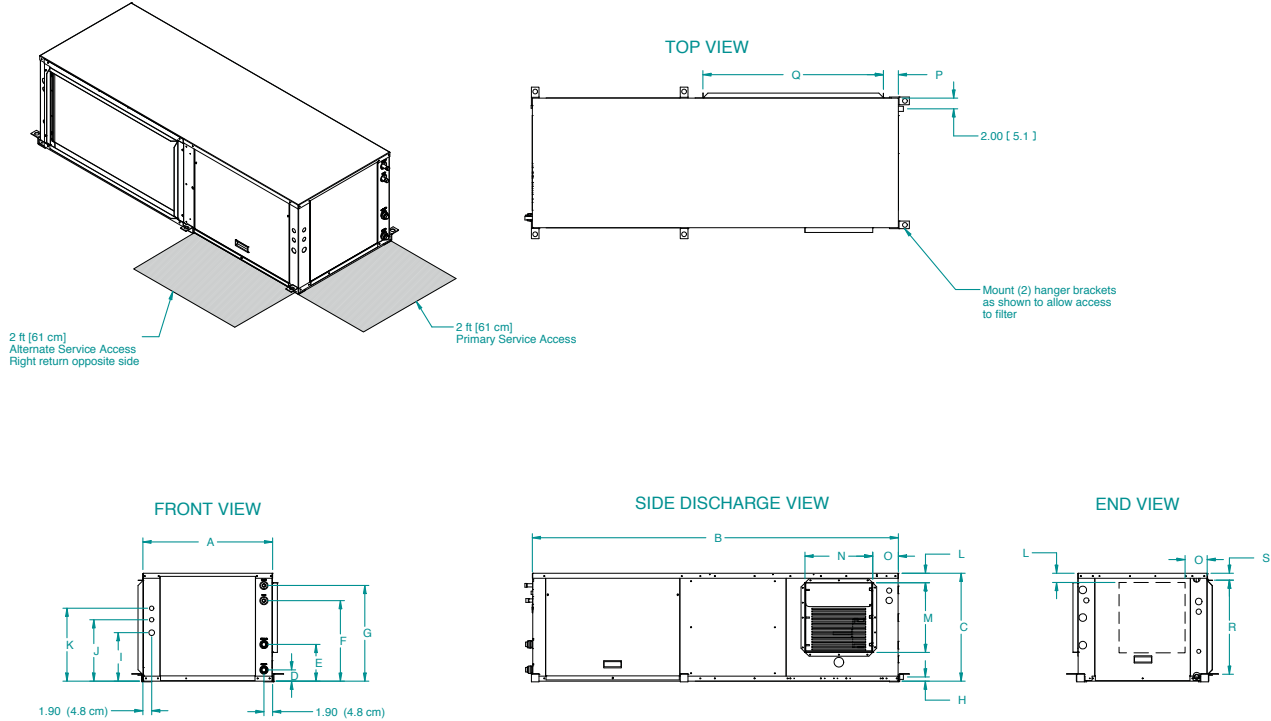

Horizontal Model	Overall Cabinet			Water Connections							Electrical Connections			Discharge Connection Duct Flange Installed				Return Connection Return Duct Flanges				
	A	B	C	D	E	F	G	H	Loop Water FPT	HWG Sweat (I.D.)	I	J	K	L*	M	N	O*	P	Q	R	S	
	Width	Depth	Height	In	Out	HWG In	HWG Out	Condensate			3/4" cond Power Supply	1/2" cond Ext Pump	1/2" cond Low Voltage									Supply Height
024	in.	22.5	53.0	19.3	2.3	5.3	13.8	16.8	0.8	1"	1/2"	8.9	11.5	13.7	1.7	10.5	9.5	8.2	2.2	21.8	16.5	1.5
	cm.	57.2	134.6	49.0	5.8	13.5	35.1	42.7	2.0	Swivel	female	22.6	29.2	34.8	4.3	26.7	24.1	20.8	5.6	55.4	41.9	3.8
036	in.	22.5	63.0	19.3	2.3	7.3	13.5	16.5	0.8	1"	1/2"	9.5	12.1	14.3	2.3	10.5	9.5	5.7	2.8	30.5	16.7	1.3
	cm.	57.2	160.0	49.0	5.8	18.5	34.3	41.9	2.0	Swivel	female	24.1	30.7	36.3	5.8	26.7	24.1	14.5	7.1	77.5	42.4	3.3
048-	in.	25.6	72.0	21.3	2.3	7.3	15.9	18.9	0.8	1"	1/2"	9.5	12.1	14.3	1.9	13.6	13.2	5.0	2.9	35.5	18.6	1.3
060	cm.	65.0	182.9	54.1	5.8	18.5	40.4	48.0	2.0	Swivel	female	24.1	30.7	36.3	4.8	34.5	33.5	12.7	7.4	90.2	47.2	3.3
072	in.	25.6	77.0	21.3	2.3	7.3	15.9	18.9	0.8	1"	1/2"	9.5	12.1	14.3	1.9	13.6	13.2	5.0	2.8	40.4	18.7	1.5
	cm.	65.0	195.6	54.1	5.8	18.5	40.4	48.0	2.0	Swivel	female	24.1	30.7	36.3	4.8	34.5	33.5	12.7	7.1	102.6	47.5	3.8

\* Dimensions shown are for left return side discharge other configurations shown in tables below  
 Condensate is 3/4" PVC female glue socket and is switchable from side to front  
 Unit shipped with 1" [25.4mm] return duct flanges suitable for duct connection.  
 Discharge flange is field installed and extends 1" [25.4mm] from cabinet  
 Water connections extend 1.2" [30.5mm] beyond front of cabinet.  
 The optional 1" filter rack (not shown) has the same return opening connection size as the duct flanges shown in the drawing. The filter rack extends 2.25"(57.1 mm) from the unit.  
 The optional 1" filter rack is suitable for duct connection.  
 The optional filter rails (not shown) extend 1.25" (31.75 mm) from cabinet.  
 The 024 model is not field convertible changing from end to side discharge. It requires an additional discharge panel (not supplied).

024 Model		L	O	036 Model		L	O	048-060 Models		L	O	072 Model		L	O
Right Return End Discharge	in	2.2	5.7	Right Return End Discharge	in	6.5	6.6	Right Return End Discharge	in	1.9	5.0	Right Return End Discharge	in	1.9	5.0
	cm	5.6	14.5		cm	16.5	16.8		cm	4.8	12.7		cm	4.8	12.7
Right Return Side Discharge	in	6.9	8.3	Right Return Side Discharge	in	2.3	5.7	Right Return Side Discharge	in	5.7	5.0	Right Return Side Discharge	in	5.7	5.0
	cm	17.5	21.1		cm	5.8	14.5		cm	14.5	12.7		cm	14.5	12.7
Left Return End Discharge	in	6.5	7.3	Left Return End Discharge	in	6.5	6.6	Left Return End Discharge	in	5.7	4.9	Left Return End Discharge	in	5.7	5.0
	cm	16.5	18.5		cm	16.5	16.8		cm	14.5	12.4		cm	14.5	12.7

©2014 The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products.

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## Physical Data cont.

Model		Dual Capacity				
		024	036	048	060	072
Compressor (1 each)		Copeland Ultra Tech, Dual Capacity Scroll				
Factory Charge R410a, oz [kg]	Vertical	39 [1.05]	52 [1.47]	68 [1.93]	76 [2.15]	88 [2.49]
Factory Charge R410a, oz [kg]	Horizontal	38 [1.08]	52 [1.47]	68 [1.93]	72 [2.04]	85 [2.41]
<b>ECM Blower Motor &amp; Blower</b>						
Blower Motor Type/Speeds	ECM	5 Speed ECM				
Blower Motor- hp [W]	ECM	1/2 [373]	1/2 [373]	1 [746]	1 [746]	1 [746]
Blower Wheel Size (Dia x W), in. [mm]	ECM	9 x 7 [229 x 178]	9 x 7 [229 x 178]	11 x 10 [279 x 254]	11 x 10 [279 x 254]	11 x 10 [279 x 254]
<b>Coax and Water Piping</b>						
Water Connections Size - Swivel - in [mm]		1" [25.4]	1" [25.4]	1" [25.4]	1" [25.4]	1" [25.4]
HWG Connection Size - Female Sweat I.D. - in [mm]		1/2" [12.7]	1/2" [12.7]	1/2" [12.7]	1/2" [12.7]	1/2" [12.7]
Coax & Piping Water Volume - gal [l]		.35 [1.3]	.7 [2.6]	.7 [2.6]	1.3 [4.9]	1.6 [6.1]
<b>Vertical</b>						
Air Coil Dimensions (H x W), in. [mm]		19 x 20 [483 x 508]	24 x 20 [610 x 508]	28 x 25 [711 x 635]	28 x 25 [711 x 635]	32 x 25 [813 x 635]
Air Coil Total Face Area, ft2 [m2]		2.6 [0.245]	3.3 [0.310]	4.9 [0.452]	4.9 [0.452]	5.6 [0.516]
Air Coil Tube Size, in [mm]		3/8 [9.5]	3/8 [9.5]	3/8 [9.5]	3/8 [9.5]	3/8 [9.5]
Air Coil Number of rows		3	3	3	3	3
Optional Filter - 1" [25mm] Pleated MERV8 Throwaway, in [mm]		20 x 24 [508 x 610]	24 x 24 [610 x 610]	28 x 30 [711 x 762]	28 x 30 [711 x 762]	30 x 32 [762 x 813]
Weight - Operating, lb [kg]		198 [90]	221 [100]	303 [137]	329 [149]	350 [159]
Weight - Packaged, lb [kg]		218 [99]	241 [109]	323 [147]	349 [158]	370 [168]
<b>Horizontal</b>						
Air Coil Dimensions (H x W), in. [mm]		18 x 21 [457 x 533]	18 x 27 [457 x 686]	20 x 35 [508 x 889]	20 x 35 [508 x 889]	20 x 40 [508 x 1016]
Air Coil Total Face Area, ft2 [m2]		2.6 [0.244]	3.4 [0.314]	4.9 [0.452]	4.9 [0.452]	5.6 [0.516]
Air Coil Tube Size, in [mm]		3/8 [9.5]	3/8 [9.5]	3/8 [9.5]	3/8 [9.5]	3/8 [9.5]
Air Coil Number of rows		3	3	3	3	3
Optional Filter - 1" [25mm] Pleated MERV8 Throwaway, in [mm]		1 - 18 x 24 [457 x 610]	1 - 18 x 32 [457 x 813]	1 - 20 x 37 [508 x 940]	1 - 20 x 37 [508 x 940]	1 - 20 x 20 [508 x 508] 1 - 20 x 22 [508 x 559]
Weight - Operating, lb [kg]		228 [103]	250 [113]	325 [147]	358 [162]	369 [167]
Weight - Packaged, lb [kg]		248 [112]	270 [122]	345 [156]	378 [171]	389 [176]

12/14/2016

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## Auxiliary Heat Ratings

Model	KW		Stages	BTU/HR		Min CFM			
	208V	230V		208V	230V		024	036	048 - 072
EAM(H)5*	3.6	4.8	1	12,300	16,300	450	●	●	
EAM(H)8*	5.7	7.6	2	19,400	25,900	550	●	●	
EAM(H)10*	7.2	9.6	2	24,600	32,700	650	●	●	
EAL(H)10*	7.2	9.6	2	24,600	32,700	1100			●
EAL(H)15*	10.8	14.4	2	36,900	49,100	1250			●
EAL(H)20*	14.4	19.2	2	49,200	65,500	1500			●

Order the "H" part number when installed on horizontal units

Air flow level for auxiliary heat (Aux) must be equal to or above the minimum CFM in this table

6/9/2014

## Auxiliary Heat Electrical Data

Model	Supply Circuit	Heater Amps		Min Circuit Amp		Fuse (USA)		Fuse (CAN)		CKT BRK	
		208 V	240 V	208 V	240 V	208 V	240 V	208 V	240 V	208 V	240 V
EAM(H)5*	Single	17.3	20.0	26.7	30.0	30	30	30	30	30	30
EAM(H)8*	Single	27.5	31.7	39.3	44.6	40	45	40	45	40	45
EAM(H)10*	Single	34.7	40.0	48.3	55.0	50	60	50	60	50	60
EAL(H)10*	Single	34.7	40.0	53.3	60.0	60	60	60	60	60	60
EAL(H)15*	Single	52.0	60.0	75.0	85.0	80	90	80	90	70	100
	L1/L2	34.7	40.0	53.3	60.0	60	60	60	60	60	60
	L3/L4	17.3	20.0	21.7	25.0	25	25	25	25	20	30
EAL(H)20*	Single	69.3	80.0	96.7	110.0	100	110	100	110	100	100
	L1/L2	34.7	40.0	53.3	60.0	60	60	60	60	60	60
	L3/L4	34.7	40.0	43.3	50.0	45	50	45	50	40	50

All heaters rated single phase 60 cycle and include unit fan load

All fuses type "D" time delay (or HACR circuit breaker in USA)

Supply wire size to be determined by local codes

3/10/14

## Electrical Data

### Dual Capacity Unit with 5 Speed ECM Motor

Model	Rated Voltage	Voltage Min/Max	Compressor				HWG Pump FLA	Ext Loop FLA	Blower Motor FLA	Total Unit FLA	Min Circ Amp	Max Fuse/HACR
			MCC	RLA	LRA	LRA**						
024	208-230/60/1	187/253	18.2	11.6	58.3	21.0	0.4	5.4	4.1	21.5	24.5	35
036	208-230/60/1	187/253	23.8	15.2	83.0	30.0	0.4	5.4	4.1	25.1	28.9	40
048	208-230/60/1	187/253	33.0	21.1	104.0	37.0	0.4	5.4	7.6	34.5	39.8	60
060	208-230/60/1	187/253	42.3	27.1	152.9	54.0	0.4	5.4	7.6	40.5	47.2	70
072	208-230/60/1	187/253	46.3	29.6	179.2	63.0	0.4	5.4	7.6	43.0	50.4	80

\*\*With optional IntelliStart

Rated Voltage of 208/230/60/1

HACR circuit breaker in USA only

All fuses Class RK-5

6/9/14



Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## Blower Performance Data

### Dual Capacity with 5-Speed ECM

Model	Motor Speed	Motor Tap	T'stat Cnct.	Blower Size	Motor HP	Airflow (cfm) at External Static Pressure (in. wg)															
						0	0.05	0.1	0.15	0.2	0.25	0.3	0.35	0.4	0.45	0.5	0.6	0.7	0.8	0.9	1.00
024	<b>High</b>	<b>5</b>	W	9 x 7	1/2	1024	1013	1002	988	974	963	951	940	929	901	872	785	691	-	-	-
	<b>Med High</b>	<b>4</b>	Y2			932	917	902	892	882	867	851	842	832	817	802	756	661	-	-	-
	Med	3				835	826	816	801	785	772	759	749	738	719	700	677	636	-	-	-
	<b>Med Low</b>	<b>2</b>	Y1			765	747	729	720	710	696	681	662	643	627	611	581	515	-	-	-
	<b>Low</b>	<b>1</b>	G			665	656	647	626	605	593	580	561	541	519	496	443	392	-	-	-
036	<b>High</b>	<b>5</b>	W	9 x 7	1/2	1325	1319	1313	1293	1272	1242	1212	1158	1103	1058	1013	930	839	-	-	-
	<b>Med High</b>	<b>4</b>	Y2			1279	1267	1254	1238	1222	1203	1184	1137	1089	1049	1008	926	836	-	-	-
	Med	3				1229	1218	1206	1187	1167	1154	1140	1110	1079	1044	1008	929	829	-	-	-
	<b>Med Low</b>	<b>2</b>	Y1			1201	1184	1167	1156	1145	1129	1113	1086	1058	1028	997	914	808	-	-	-
	<b>Low</b>	<b>1</b>	G			1007	989	971	958	945	925	904	889	873	862	850	818	778	-	-	-
048	<b>High</b>	<b>5</b>	W	11 x 10	1	1890	1874	1857	1845	1833	1809	1784	1769	1754	1736	1718	1672	1629	1601	1562	1522
	<b>Med High</b>	<b>4</b>	Y2			1769	1754	1739	1721	1703	1685	1666	1645	1623	1604	1585	1539	1499	1463	1432	1376
	Med	3				1671	1652	1632	1614	1595	1576	1557	1536	1514	1494	1474	1430	1387	1351	1313	1173
	<b>Med Low</b>	<b>2</b>	Y1			1574	1555	1535	1514	1492	1472	1452	1431	1410	1387	1363	1330	1284	1236	1108	1014
	<b>Low</b>	<b>1</b>	G			1388	1370	1352	1322	1292	1264	1236	1216	1195	1178	1161	1095	984	916	842	787
060	<b>High</b>	<b>5</b>	W	11 x 10	1	2077	2066	2055	2044	2033	2017	2000	1966	1931	1904	1877	1841	1810	1791	1740	1653
	<b>Med High</b>	<b>4</b>	Y2			1948	1937	1925	1910	1895	1880	1865	1831	1797	1778	1759	1720	1707	1680	1660	1612
	Med	3				1810	1794	1778	1739	1700	1684	1667	1657	1646	1629	1612	1576	1583	1547	1510	1480
	<b>Med Low</b>	<b>2</b>	Y1			1680	1667	1653	1618	1583	1562	1540	1522	1503	1488	1473	1465	1449	1410	1369	1319
	<b>Low</b>	<b>1</b>	G			1594	1572	1550	1512	1474	1450	1426	1410	1393	1385	1376	1351	1325	1290	1168	1085
072	<b>High</b>	<b>5</b>	W	11 x 10	1	2402	2388	2373	2358	2343	2334	2325	2307	2289	2274	2258	2215	2177	2125	2052	1933
	<b>Med High</b>	<b>4</b>	Y2			2209	2193	2177	2164	2151	2135	2118	2105	2092	2072	2052	2017	1982	1954	1925	1844
	Med	3				2085	2072	2058	2045	2031	2010	1989	1972	1954	1936	1918	1881	1852	1821	1790	1751
	<b>Med Low</b>	<b>2</b>	Y1			1961	1951	1940	1926	1911	1885	1859	1844	1829	1814	1798	1759	1727	1703	1670	1636
	<b>Low</b>	<b>1</b>	G			1767	1751	1735	1715	1694	1678	1661	1640	1619	1602	1584	1548	1512	1475	1426	1397

Factory speed settings are in Bold

Air flow values are with dry coil and standard filter

For wet coil performance first calculate the face velocity of the air coil (Face Velocity [fpm] = Airflow [cfm] / Face Area [sq ft]).


Then for velocities of 200 fpm reduce the static capability by 0.03 in. wg, 300 fpm by 0.08 in. wg, 400 fpm by 0.12 in. wg., and 500 fpm by 0.16 in. wg.

Highest setting is for auxiliary heat (W) and lowest setting is for constant blower (G). The "Y1" and "Y2" settings must be between the "G" and "W" settings.


7/30/14

### Setting Blower Speed - 5-Speed ECM

5-Speed ECM blower motors have five (5) speeds of which four (4) are selectable on dual capacity.

 **CAUTION: Disconnect all power before performing this operation.**

#### 5-Speed ECM Motor Connections - Dual Capacity

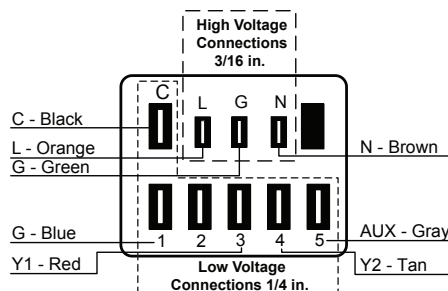

©2014 The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products.

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## Operating Limits

Operating Limits	Cooling		Heating	
	(°F)	(°C)	(°F)	(°C)
Air Limits				
Min. Ambient Air	45	7.2	45	7.2
Rated Ambient Air	80	26.7	70	21.1
Max. Ambient Air	100	37.8	85	29.4
Min. Entering Air	50	10.0	40	4.4
Rated Entering Air db/wb	80.6/66.2	27/19	68	20.0
Max. Entering Air db/wb	110/83	43/28.3	80	26.7
Water Limits				
Min. Entering Water	30	-1.1	20	-6.7
Normal Entering Water	50-110	10-43.3	30-70	-1.1
Max. Entering Water	120	48.9	90	32.2

Notes: Minimum/maximum limits are only for start-up conditions, and are meant for bringing the space up to occupancy temperature. Units are not designed to operate at the minimum/maximum conditions on a regular basis. The operating limits are dependent upon three primary factors: 1) water temperature, 2) return air temperature, and 3) ambient temperature. When any of the factors are at the minimum or maximum levels, the other two factors must be at the normal level for proper and reliable unit operation.

## Definitions

### Abbreviations and Definitions

cfm = airflow, cubic feet/minute

EWT = entering water temperature, Fahrenheit

gpm = water flow in gallons/minute

WPD = water pressure drop, psi and feet of water

EAT = entering air temperature, Fahrenheit (dry bulb/wet bulb)

HC = air heating capacity, MBtu/h

TC = total cooling capacity, MBtu/h

SC = sensible cooling capacity, MBtu/h

kW = total power unit input, kilowatts

HR = total heat of rejection, MBtu/h

HE = total heat of extraction, MBtu/h

HWC = hot water generator capacity, MBtu/h

EER = Energy Efficient Ratio

= Btu output/Watt input

COP = Coefficient of Performance

= Btu output/Btu input

LWT = leaving water temperature, °F

LAT = leaving air temperature, °F

TH = total heating capacity, MBtu/h

LC = latent cooling capacity, MBtu/h

S/T = sensible to total cooling ratio

### Notes to Performance Data Tables

The following notes apply to all performance data tables:

- Performance ratings are based on 80°F DB/67°F WB EAT for cooling and 70°F DB EAT for heating.
- Three flow rates are shown for each unit. The lowest flow rate shown is used for geothermal open loop/well water systems with a minimum of 50°F EWT. The middle flow rate shown is the minimum geothermal closed loop flow rate. The highest flow rate shown is optimum for geothermal closed loop systems and the suggested flow rate for boiler/tower applications.
- The hot water generator numbers are based on a flow rate of 0.4 gpm/ton of rated capacity with an EWT of 90°F.
- Entering water temperatures below 40°F assumes 15% antifreeze solution.
- For non-standard EAT conditions, apply the appropriate Correction Factor tables.
- Interpolation between EWT, gpm, and cfm data is permissible, extrapolation is not.

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## Correction Factor Tables

### Air Flow Corrections (Dual Capacity Part Load)

Airflow		Cooling				Heating		
cfm Per Ton of Clg	% of Nominal	Total Cap	Sens Cap	Power	Heat of Rej	Htg Cap	Power	Heat of Ext
240	60	0.922	0.778	0.956	0.924	0.943	1.239	0.879
275	69	0.944	0.830	0.962	0.944	0.958	1.161	0.914
300	75	0.957	0.866	0.968	0.958	0.968	1.115	0.937
325	81	0.970	0.900	0.974	0.970	0.977	1.075	0.956
350	88	0.982	0.933	0.981	0.980	0.985	1.042	0.972
375	94	0.991	0.968	0.991	0.991	0.993	1.018	0.988
<b>400</b>	<b>100</b>	<b>1.000</b>	<b>1.000</b>	<b>1.000</b>	<b>1.000</b>	<b>1.000</b>	<b>1.000</b>	<b>1.000</b>
425	106	1.007	1.033	1.011	1.008	1.007	0.990	1.010
450	113	1.013	1.065	1.023	1.015	1.012	0.987	1.018
475	119	1.017	1.099	1.037	1.022	1.018	0.984	1.025
500	125	1.020	1.132	1.052	1.027	1.022	0.982	1.031
520	130	1.022	1.159	1.064	1.030	1.025	0.979	1.034

5/30/06

### Air Flow Corrections (Dual Capacity Full Load and Single Speed)

Airflow		Cooling				Heating		
cfm Per Ton of Clg	% of Nominal	Total Cap	Sens Cap	Power	Heat of Rej	Htg Cap	Power	Heat of Ext
240	60	0.922	0.786	0.910	0.920	0.943	1.150	0.893
275	69	0.944	0.827	0.924	0.940	0.958	1.105	0.922
300	75	0.959	0.860	0.937	0.955	0.968	1.078	0.942
325	81	0.971	0.894	0.950	0.967	0.977	1.053	0.959
350	88	0.982	0.929	0.964	0.978	0.985	1.031	0.973
375	94	0.992	0.965	0.982	0.990	0.993	1.014	0.988
<b>400</b>	<b>100</b>	<b>1.000</b>	<b>1.000</b>	<b>1.000</b>	<b>1.000</b>	<b>1.000</b>	<b>1.000</b>	<b>1.000</b>
425	106	1.007	1.034	1.020	1.010	1.007	0.990	1.011
450	113	1.012	1.065	1.042	1.018	1.013	0.983	1.020
475	119	1.017	1.093	1.066	1.026	1.018	0.980	1.028
500	125	1.019	1.117	1.092	1.033	1.023	0.978	1.034
520	130	1.020	1.132	1.113	1.038	1.026	0.975	1.038

### Cooling Capacity Corrections

Entering Air WB °F	Total Clg Cap	Sensible Cooling Capacity Multipliers - Entering DB °F										Power Input	Heat of Rejection
		60	65	70	75	80	80.6	85	90	95	100		
55	0.898	0.723	0.866	1.048	1.185	*	*	*	*	*	*	0.985	0.913
60	0.912		0.632	0.880	1.078	1.244	1.260	*	*	*	*	0.994	0.927
63	0.945			0.768	0.960	1.150	1.175	*	*	*	*	0.996	0.954
65	0.976			0.694	0.881	1.079	1.085	1.270	*	*	*	0.997	0.972
66.2	0.983			0.655	0.842	1.040	1.060	1.232	*	*	*	0.999	0.986
<b>67</b>	<b>1.000</b>			0.616	0.806	<b>1.000</b>	1.023	1.193	1.330	1.480	*	<b>1.000</b>	<b>1.000</b>
70	1.053				0.693	0.879	0.900	1.075	1.205	1.404	*	1.003	1.044
75	1.168					0.687	0.715	0.875	1.040	1.261	1.476	1.007	1.141

NOTE: \* Sensible capacity equals total capacity at conditions shown.

3/28/12

### Heating Capacity Corrections

Ent Air DB °F	Heating Corrections		
	Htg Cap	Power	Heat of Ext
45	1.062	0.739	1.158
50	1.050	0.790	1.130
55	1.037	0.842	1.096
60	1.025	0.893	1.064
65	1.012	0.945	1.030
68	1.005	0.976	1.012
<b>70</b>	<b>1.000</b>	<b>1.000</b>	<b>1.000</b>
75	0.987	1.048	0.970
80	0.975	1.099	0.930

11/10/09

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## Antifreeze Corrections

Catalog performance can be corrected for antifreeze use. Please use the following table and note the example given.

Antifreeze Type EWT - °F [°C]	Antifreeze % by wt	Heating 30 [-1.1]	Cooling 90 [32.2]	Pressure Drop 30 [-1.1]
Water	0	1.000	1.000	1.000
	10	0.973	0.991	1.075
Ethylene Glycol	20	0.943	0.979	1.163
	30	0.917	0.965	1.225
	40	0.890	0.955	1.324
	50	0.865	0.943	1.419
	10	0.958	0.981	1.130
Propylene Glycol	20	0.913	0.969	1.270
	30	0.854	0.950	1.433
	40	0.813	0.937	1.614
	50	0.770	0.922	1.816
	10	0.927	0.991	1.242
Ethanol	20	0.887	0.972	1.343
	30	0.856	0.947	1.383
	40	0.815	0.930	1.523
	50	0.779	0.911	1.639
	10	0.957	0.986	1.127
Methanol	20	0.924	0.970	1.197
	30	0.895	0.951	1.235
	40	0.863	0.936	1.323
	50	0.833	0.920	1.399



**WARNING:** Gray area represents antifreeze concentrations greater than 35% by weight and should be avoided due to the extreme performance penalty they represent.

### Antifreeze Correction Example

Antifreeze solution is Propylene Glycol 20% by weight. Determine the corrected heating and cooling performance at 30°F and 90°F respectively as well as pressure drop at 30°F for a 036.

The corrected cooling capacity at 90°F would be: 34,800 Btu/h x 0.969 = 33,721 Btu/h

The corrected heating capacity at 30°F would be: 29,300 Btu/h x 0.913 = 26,750 Btu/h

The corrected pressure drop at 30°F and 9 gpm would be: 13.4 feet of head x 1.270 = 17.02 feet of head

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## Pressure Drop

Model	GPM	Pressure Drop (psi)				
		30°F	50°F	70°F	90°F	110°F
024 Full Load	4	2.3	2.1	2.0	1.9	1.7
	6	4.5	4.3	4.0	3.7	3.5
	8	7.5	7.0	6.6	6.1	5.7
	10	10.5	9.7	9.9	8.5	7.9
024 Part Load	3	1.5	1.4	1.3	1.2	1.1
	5	3.3	3.1	2.9	2.7	2.5
	7	5.9	5.6	5.2	4.8	4.5
	9	8.5	8.1	8.2	6.9	6.5
036 Full Load	5	1.9	1.8	1.7	1.6	1.5
	7	3.6	3.4	3.2	3.0	2.9
	9	5.8	5.4	5.1	4.8	4.6
	11	8.0	7.4	7.4	6.6	6.3
036 Part Load	4	1.4	1.3	1.2	1.2	1.0
	6	2.7	2.6	2.4	2.3	2.1
	8	4.7	4.4	4.1	4.0	3.5
	10	6.7	6.2	6.2	5.7	4.9
048 Full Load	6	1.7	1.6	1.5	1.4	1.3
	9	3.9	3.6	3.4	3.2	3.1
	12	7.0	6.6	6.2	5.8	5.6
	15	10.1	9.6	9.8	8.4	8.1
048 Part Load	5	1.1	1.1	1.0	0.9	0.9
	8	3.1	2.9	2.7	2.5	2.3
	11	5.9	5.6	5.2	4.8	4.5
	14	8.7	8.3	8.5	7.1	6.7
060 Full Load	8	2.8	2.7	2.5	2.3	2.2
	12	5.8	5.4	5.1	4.8	4.4
	16	9.8	9.2	8.6	8.0	7.4
	20	13.8	13.0	13.0	11.2	10.4
060 Part Load	6	1.7	1.6	1.5	1.4	1.3
	10	4.2	4.0	3.7	3.4	3.2
	14	7.6	7.2	6.7	6.2	5.8
	18	11.0	10.4	10.7	9.0	8.4
072 Full Load	12	3.8	3.6	3.4	3.1	2.9
	15	5.7	5.3	5.0	4.7	4.3
	18	7.8	7.4	6.9	6.4	6.0
	21	9.9	9.5	9.1	8.1	7.7
072 Part Load	10	2.8	2.7	2.5	2.3	2.2
	13	4.4	4.2	3.9	3.6	3.4
	16	6.4	6.0	5.6	5.2	4.8
	19	8.4	7.8	7.6	6.8	6.2

7/18/14

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## Performance Data cont.

### 024 - Full Load Dual Capacity with 5-Speed ECM (800 cfm)

EWT °F	Flow gpm	WPD		HEATING - EAT 70°F							COOLING - EAT 80/67 °F								
		PSI	FT	Airflow cfm	HC Mbtu/h	Power kW	HE Mbtu/h	LAT °F	COP	HWC Mbtu/h	Airflow cfm	TC Mbtu/h	SC Mbtu/h	S/T Ratio	Power kW	HR Mbtu/h	EER	HWC Mbtu/h	
20	4.0	2.3	5.4	Operation not recommended							Operation not recommended								
	6.0	4.7	10.8	Operation not recommended							Operation not recommended								
	8.0	7.7	17.8	600	16.0	1.47	10.9	94.6	3.19	2.1									
				800	16.5	1.51	11.3	89.1	3.19	2.0									
30	4.0	2.3	5.3	Operation not recommended							Operation not recommended								
	6.0	4.5	10.5	600	18.3	1.51	13.2	98.3	3.56	2.3	600	24.7	17.0	0.69	1.00	28.1	24.7	-	
				800	18.9	1.56	13.5	91.8	3.55	2.1	800	25.1	18.6	0.74	1.05	28.7	23.8	-	
	8.0	7.5	17.3	600	18.6	1.52	13.4	98.8	3.58	2.3	600	24.8	17.0	0.69	0.97	28.1	25.6	-	
800				19.2	1.57	13.9	92.3	3.59	2.2	800	25.4	18.6	0.73	1.02	28.9	25.0	-		
40	4.0	2.2	5.1	Operation not recommended							Operation not recommended								
	6.0	4.4	10.2	600	20.9	1.58	15.5	102.2	3.86	2.5	600	25.0	17.2	0.69	1.10	28.7	22.7	-	
				800	21.5	1.62	16.0	94.9	3.90	2.3	800	25.4	18.8	0.74	1.15	29.4	22.1	-	
	8.0	7.3	16.8	600	21.3	1.60	15.8	102.9	3.90	2.6	600	25.2	17.2	0.68	1.07	28.8	23.6	-	
800				22.0	1.63	16.4	95.4	3.94	2.4	800	25.7	18.8	0.73	1.12	29.5	23.1	-		
50	4.0	2.1	4.9	600	22.6	1.62	17.1	104.9	4.09	2.7	600	24.0	15.8	0.66	1.26	28.3	19.1	1.1	
				800	23.3	1.64	17.7	96.9	4.15	2.5	800	25.2	17.6	0.70	1.32	29.8	19.1	1.2	
	6.0	4.3	9.9	600	23.4	1.66	17.8	106.2	4.14	2.8	600	24.5	16.0	0.65	1.19	28.5	20.7	1.0	
				800	24.2	1.68	18.4	98.0	4.22	2.6	800	25.8	17.8	0.69	1.24	30.0	20.7	1.2	
8.0	7.0	16.3	600	24.0	1.67	18.2	107.0	4.20	2.9	600	24.7	17.1	0.69	1.16	28.7	21.4	1.0		
			800	24.7	1.69	18.9	98.6	4.27	2.6	800	26.0	19.0	0.73	1.22	30.2	21.4	1.1		
60	4.0	2.1	4.8	600	24.7	1.68	19.0	108.2	4.32	3.0	600	23.4	15.7	0.67	1.37	28.1	17.1	1.3	
				800	25.5	1.69	19.8	99.5	4.43	2.8	800	24.6	17.5	0.71	1.43	29.5	17.1	1.4	
	6.0	4.1	9.6	600	25.8	1.73	20.0	109.9	4.39	3.0	600	24.0	15.9	0.66	1.30	28.4	18.4	1.2	
				800	26.7	1.74	20.8	100.9	4.50	2.8	800	25.1	17.7	0.70	1.36	29.8	18.5	1.4	
8.0	6.8	15.8	600	26.5	1.74	20.5	110.8	4.45	3.2	600	24.2	16.8	0.69	1.27	28.6	19.0	1.1		
			800	27.3	1.75	21.4	101.6	4.58	2.9	800	25.4	18.6	0.73	1.33	30.0	19.1	1.3		
70	4.0	2.0	4.6	600	26.9	1.74	21.0	111.5	4.54	3.2	600	22.9	15.6	0.68	1.49	28.0	15.4	1.6	
				800	27.8	1.74	21.9	102.2	4.69	3.0	800	23.9	17.4	0.73	1.54	29.2	15.5	1.7	
	6.0	4.0	9.2	600	28.3	1.79	22.1	113.6	4.62	3.4	600	23.5	15.8	0.67	1.42	28.4	16.5	1.5	
				800	29.2	1.79	23.1	103.8	4.77	3.1	800	24.5	17.5	0.72	1.47	29.5	16.6	1.7	
8.0	6.6	15.3	600	29.0	1.82	22.8	114.7	4.68	3.5	600	23.7	16.5	0.69	1.39	28.5	17.1	1.4		
			800	30.0	1.81	23.8	104.7	4.86	3.2	800	24.8	18.2	0.74	1.45	29.7	17.2	1.6		
80	4.0	1.9	4.5	600	28.9	1.80	22.8	114.6	4.71	3.6	600	21.9	15.5	0.71	1.63	27.5	13.4	2.0	
				800	29.9	1.78	23.8	104.6	4.91	3.3	800	22.8	17.2	0.75	1.68	28.5	13.5	2.1	
	6.0	3.9	8.9	600	30.6	1.87	24.2	117.1	4.79	3.7	600	22.5	15.7	0.70	1.58	27.9	14.3	1.9	
				800	31.6	1.85	25.3	106.6	5.00	3.5	800	23.4	17.4	0.74	1.62	29.0	14.4	2.1	
8.0	6.4	14.7	600	31.4	1.89	25.0	118.5	4.87	3.9	600	22.8	16.1	0.70	1.54	28.0	14.8	1.8		
			800	32.5	1.87	26.1	107.6	5.11	3.6	800	23.7	17.8	0.75	1.59	29.1	14.9	2.0		
90	4.0	1.9	4.3	600	30.9	1.86	24.6	117.7	4.87	3.9	600	21.0	15.3	0.73	1.78	27.0	11.8	2.5	
				800	32.0	1.83	25.8	107.0	5.12	3.7	800	21.7	17.0	0.78	1.82	27.9	11.9	2.7	
	6.0	3.7	8.6	600	32.8	1.94	26.2	120.7	4.95	4.1	600	21.6	15.5	0.72	1.73	27.5	12.5	2.4	
				800	34.0	1.91	27.5	109.4	5.22	3.8	800	22.4	17.2	0.77	1.77	28.4	12.6	2.6	
8.0	6.1	14.2	600	33.9	1.97	27.2	122.3	5.04	4.3	600	21.8	15.6	0.72	1.70	27.6	12.8	2.2		
			800	35.0	1.92	28.5	110.6	5.34	4.0	800	22.6	17.3	0.77	1.74	28.5	13.0	2.5		
100	4.0	1.8	4.2	Operation not recommended							Operation not recommended								
	6.0	3.6	8.3	600	20.4	1.52	15.2	95.2	3.52	2.3	600	20.4	15.2	0.75	1.92	26.9	10.6	2.9	
				800	21.1	1.69	0.80	1.95	27.7	10.8	3.2	800	21.1	16.9	0.80	1.95	27.7	10.8	3.2
	8.0	5.9	13.7	600	20.6	1.52	0.74	1.88	27.0	10.9	2.7	600	20.6	15.2	0.74	1.88	27.0	10.9	2.7
800				21.3	1.68	0.79	1.91	27.8	11.1	3.0	800	21.3	16.8	0.79	1.91	27.8	11.1	3.0	
110	4.0	1.7	4.0	Operation not recommended							Operation not recommended								
	6.0	3.5	8.0	600	19.2	1.50	0.78	2.11	26.4	9.1	3.7	600	19.2	15.0	0.78	2.11	26.4	9.1	3.7
				800	19.8	1.66	0.84	2.12	27.0	9.3	4.0	800	19.8	16.6	0.84	2.12	27.0	9.3	4.0
	8.0	5.7	13.2	600	19.4	1.48	0.76	2.07	26.5	9.4	3.4	600	19.4	14.8	0.76	2.07	26.5	9.4	3.4
800				20.0	1.63	0.82	2.09	27.1	9.5	3.8	800	20.0	16.3	0.82	2.09	27.1	9.5	3.8	
120	4.0	1.7	3.8	Operation not recommended							Operation not recommended								
	6.0	3.3	7.7	600	17.4	1.44	0.83	2.31	25.3	7.5	4.3	600	17.4	14.4	0.83	2.31	25.3	7.5	4.3
				800	17.7	1.57	0.88	2.37	25.8	7.5	4.7	800	17.7	15.7	0.88	2.37	25.8	7.5	4.7
	8.0	5.5	12.7	600	17.5	1.44	0.82	2.23	25.2	7.9	4.0	600	17.5	14.4	0.82	2.23	25.2	7.9	4.0
800				17.9	1.57	0.87	2.31	25.8	7.8	4.4	800	17.9	15.7	0.87	2.31	25.8	7.8	4.4	

Performance capacities shown in thousands of Mbtu/h.

7/18/14

©2014 The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products.

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## Performance Data cont.

### 024 - Part Load Dual Capacity with 5-Speed ECM (600 cfm)

EWT °F	Flow gpm	WPD		HEATING - EAT 70°F							COOLING - EAT 80/67 °F							
		PSI	FT	Airflow cfm	HC Mbtu/h	Power kW	HE Mbtu/h	LAT °F	COP	HWC Mbtu/h	Airflow cfm	TC Mbtu/h	SC Mbtu/h	S/T Ratio	Power kW	HR Mbtu/h	EER	HWC Mbtu/h
20	3.0	1.5	3.5	Operation not recommended							Operation not recommended							
	5.0	3.4	7.8	Operation not recommended							Operation not recommended							
	7.0	6.1	14.1	500	11.6	1.17	7.6	91.4	2.89	1.8	Operation not recommended							
30	3.0	1.5	3.4	Operation not recommended							Operation not recommended							
	5.0	3.3	7.6	500	12.7	1.16	8.8	93.6	3.22	1.7	500	17.7	12.6	0.71	0.64	19.9	27.7	-
	7.0	5.9	13.7	600	13.3	1.19	9.2	90.5	3.27	1.6	600	18.0	13.7	0.76	0.67	20.3	26.7	-
				500	13.6	1.19	9.5	95.1	3.35	1.8	500	17.8	12.6	0.71	0.62	19.9	28.7	-
				600	14.1	1.22	10.0	91.8	3.40	1.7	600	18.2	13.7	0.75	0.65	20.5	28.0	-
40	3.0	1.4	3.3	Operation not recommended							Operation not recommended							
	5.0	3.2	7.4	500	14.8	1.18	10.8	97.4	3.68	1.7	500	18.0	12.7	0.71	0.71	20.4	25.3	-
	7.0	5.7	13.2	600	15.3	1.20	11.2	93.7	3.73	1.6	600	18.3	13.9	0.76	0.75	20.9	24.5	-
				500	15.6	1.21	11.5	98.9	3.78	1.8	500	18.1	12.7	0.70	0.69	20.5	26.2	-
				600	16.1	1.23	11.9	94.9	3.84	1.7	600	18.5	13.9	0.75	0.72	21.0	25.7	-
50	3.0	1.4	3.2	500	16.3	1.20	12.2	100.2	3.97	1.8	500	17.8	12.3	0.69	0.80	20.6	22.2	0.5
	5.0	3.1	7.2	600	16.8	1.22	12.6	95.9	4.04	1.7	600	18.3	13.6	0.74	0.82	21.1	22.4	0.6
				500	16.9	1.20	12.8	101.2	4.11	1.8	500	18.0	12.4	0.69	0.78	20.7	23.0	0.5
				600	17.4	1.22	13.2	96.8	4.18	1.7	600	18.5	13.7	0.74	0.80	21.2	23.2	0.6
	7.0	5.6	12.8	500	17.7	1.23	13.5	102.7	4.20	2.0	500	18.3	12.7	0.69	0.78	21.0	23.6	0.5
60	3.0	1.3	3.1	500	18.3	1.23	14.1	104.0	4.37	2.0	500	17.3	12.0	0.69	0.90	20.4	19.2	0.7
				600	18.8	1.24	14.6	99.0	4.45	1.8	600	17.8	13.3	0.74	0.92	21.0	19.3	0.8
	5.0	3.0	6.9	500	19.1	1.23	14.9	105.3	4.55	2.0	500	17.5	12.1	0.69	0.88	20.5	19.9	0.7
				600	19.5	1.23	15.3	100.1	4.63	1.9	600	18.0	13.3	0.74	0.90	21.0	20.0	0.8
				500	19.7	1.26	15.5	106.5	4.61	2.1	500	17.8	12.4	0.70	0.87	20.8	20.4	0.6
7.0	5.4	12.4	600	20.2	1.26	15.9	101.1	4.69	1.9	600	18.3	13.7	0.75	0.89	21.3	20.6	0.7	
70	3.0	1.3	3.0	500	20.4	1.26	16.1	107.7	4.75	2.2	500	16.8	11.7	0.69	1.00	20.3	16.8	1.0
				600	20.8	1.26	16.5	102.0	4.84	2.0	600	17.3	12.9	0.75	1.02	20.8	16.9	1.1
	5.0	2.9	6.7	500	21.2	1.25	17.0	109.3	4.97	2.2	500	17.0	11.7	0.69	0.98	20.3	17.4	0.9
				600	21.6	1.25	17.4	103.4	5.07	2.0	600	17.5	13.0	0.74	1.00	20.9	17.5	1.0
				500	21.8	1.28	17.4	110.4	4.99	2.3	500	17.3	12.0	0.70	0.97	20.6	17.8	0.9
7.0	5.2	12.0	600	22.2	1.28	17.8	104.2	5.09	2.1	600	17.8	13.3	0.75	0.99	21.1	18.0	1.0	
80	3.0	1.3	2.9	500	22.4	1.28	18.0	111.4	5.11	2.5	500	16.0	11.4	0.71	1.13	19.9	14.2	1.4
				600	22.7	1.28	18.3	105.0	5.21	2.2	600	16.5	12.6	0.76	1.16	20.4	14.3	1.5
	5.0	2.8	6.5	500	23.4	1.28	19.1	113.4	5.39	2.5	500	16.2	11.4	0.71	1.10	20.0	14.7	1.3
				600	23.7	1.27	19.4	106.6	5.49	2.3	600	16.6	12.6	0.76	1.13	20.5	14.8	1.4
				500	23.8	1.30	19.3	114.0	5.35	2.6	500	16.5	11.7	0.71	1.09	20.2	15.0	1.2
7.0	5.0	11.6	600	24.0	1.29	19.6	107.1	5.46	2.4	600	16.9	13.0	0.77	1.12	20.7	15.2	1.3	
90	3.0	1.2	2.8	500	24.4	1.31	19.9	115.1	5.45	2.8	500	15.3	11.0	0.72	1.26	19.6	12.1	1.9
				600	24.6	1.29	20.1	107.9	5.56	2.5	600	15.7	12.2	0.78	1.29	20.1	12.2	2.0
	5.0	2.7	6.2	500	25.6	1.30	21.2	117.4	5.78	2.9	500	15.4	11.1	0.72	1.23	19.6	12.5	1.8
				600	25.8	1.28	21.4	109.8	5.90	2.6	600	15.8	12.3	0.78	1.26	20.1	12.6	1.9
				500	25.7	1.32	21.2	117.6	5.70	2.9	500	15.6	11.4	0.73	1.22	19.8	12.8	1.7
7.0	4.8	11.2	600	25.8	1.30	21.4	109.9	5.81	2.6	600	16.1	12.6	0.78	1.25	20.3	12.9	1.9	
100	3.0	1.2	2.7	Operation not recommended							Operation not recommended							
	5.0	2.6	6.0	500	14.5	10.8	0.75	1.40	19.2	10.3	2.3	Operation not recommended						
				600	14.9	12.0	0.81	1.43	19.7	10.4	2.5	Operation not recommended						
				500	14.7	11.1	0.75	1.39	19.4	10.6	2.1	Operation not recommended						
7.0	4.7	10.8	600	15.1	12.3	0.81	1.41	19.9	10.7	2.4	Operation not recommended							
110	3.0	1.1	2.6	Operation not recommended							Operation not recommended							
	5.0	2.5	5.8	500	13.5	10.5	0.78	1.57	18.9	8.7	3.1	Operation not recommended						
				600	13.9	11.7	0.84	1.60	19.4	8.7	3.3	Operation not recommended						
				500	13.8	10.8	0.78	1.55	19.1	8.9	2.9	Operation not recommended						
7.0	4.5	10.4	600	14.2	12.0	0.85	1.58	19.5	8.9	3.2	Operation not recommended							
120	3.0	1.1	2.5	Operation not recommended							Operation not recommended							
	5.0	2.4	5.6	500	12.6	10.5	0.83	1.77	18.7	7.1	3.7	Operation not recommended						
				600	12.8	11.4	0.89	1.82	19.0	7.0	4.0	Operation not recommended						
				500	12.7	10.5	0.82	1.72	18.6	7.4	3.4	Operation not recommended						
7.0	4.3	10.0	600	13.0	11.4	0.88	1.77	19.0	7.3	3.8	Operation not recommended							

Performance capacities shown in thousands of Mbtu/h.

7/18/14

©2014 The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products.

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## Performance Data cont.

### 036 - Full Load Dual Capacity with 5-Speed ECM (1200 cfm)

EWT °F	Flow gpm	WPD		HEATING - EAT 70°F							COOLING - EAT 80/67 °F							
		PSI	FT	Airflow cfm	HC MBtu/h	Power kW	HE MBtu/h	LAT °F	COP	HWC MBtu/h	Airflow cfm	TC MBtu/h	SC MBtu/h	S/T Ratio	Power kW	HR MBtu/h	EER	HWC MBtu/h
20	5.0	2.0	4.6	Operation not recommended							Operation not recommended							
	7.0	3.7	8.7	Operation not recommended							Operation not recommended							
	9.0	6.0	13.8	1000	24.4	2.27	16.6	92.6	3.15	3.3	Operation not recommended							
				1200	25.2	2.34	17.2	89.4	3.16	3.0	Operation not recommended							
30	5.0	1.9	4.5	Operation not recommended							Operation not recommended							
	7.0	3.6	8.4	1000	27.9	2.32	20.0	95.8	3.53	3.5	1000	34.1	21.8	0.64	1.58	39.5	21.7	-
				1200	28.7	2.39	20.5	92.1	3.52	3.2	1200	34.7	23.9	0.69	1.66	40.3	20.9	-
	9.0	5.8	13.4	1000	28.3	2.34	20.3	96.2	3.55	3.6	1000	34.3	21.8	0.64	1.53	39.5	22.4	-
				1200	29.3	2.41	21.0	92.6	3.55	3.3	1200	35.1	23.9	0.68	1.61	40.6	21.9	-
40	5.0	1.9	4.3	Operation not recommended							Operation not recommended							
	7.0	3.5	8.2	1000	31.6	2.43	23.3	99.3	3.81	3.8	1000	36.2	24.0	0.66	1.73	42.1	20.9	-
				1200	32.6	2.48	24.1	95.2	3.85	3.5	1200	36.9	26.1	0.71	1.81	43.1	20.3	-
	9.0	5.6	13.0	1000	32.3	2.46	23.9	99.9	3.85	3.9	1000	36.5	24.0	0.66	1.68	42.2	21.7	-
				1200	33.3	2.51	24.7	95.7	3.89	3.6	1200	37.3	26.1	0.70	1.75	43.3	21.3	-
50	5.0	1.8	4.2	1000	34.1	2.49	25.7	101.6	4.02	4.1	1000	36.3	23.7	0.65	1.97	43.1	18.4	1.8
				1200	35.2	2.52	26.6	97.1	4.08	3.8	1200	38.2	26.3	0.69	2.08	45.3	18.4	1.9
	7.0	3.4	7.9	1000	35.4	2.55	26.7	102.8	4.07	4.2	1000	37.1	24.0	0.65	1.86	43.5	20.0	1.7
				1200	36.5	2.58	27.7	98.2	4.15	3.9	1200	39.0	26.6	0.68	1.95	45.7	20.0	1.8
	9.0	5.4	12.6	1000	36.2	2.57	27.4	103.5	4.13	4.4	1000	37.5	25.6	0.68	1.81	43.7	20.7	1.6
				1200	37.3	2.60	28.4	98.8	4.20	4.0	1200	39.5	28.4	0.72	1.90	46.0	20.7	1.7
60	5.0	1.8	4.1	1000	37.5	2.59	28.6	104.7	4.24	4.6	1000	35.8	24.1	0.67	2.14	43.1	16.7	2.1
				1200	38.7	2.61	29.8	99.9	4.35	4.2	1200	37.5	26.8	0.71	2.24	45.2	16.8	2.3
	7.0	3.3	7.6	1000	39.2	2.67	30.1	106.3	4.31	4.7	1000	36.6	24.4	0.67	2.04	43.6	18.0	2.0
				1200	40.4	2.68	31.3	101.2	4.42	4.4	1200	38.4	27.0	0.70	2.12	45.6	18.1	2.2
	9.0	5.3	12.2	1000	40.1	2.69	30.9	107.2	4.36	4.9	1000	37.0	25.7	0.69	1.99	43.8	18.6	1.9
				1200	41.4	2.71	32.2	102.0	4.49	4.5	1200	38.8	28.5	0.73	2.08	45.9	18.7	2.1
70	5.0	1.7	3.9	1000	40.9	2.70	31.7	107.8	4.44	5.1	1000	35.2	24.5	0.69	2.32	43.1	15.2	2.6
				1200	42.3	2.70	33.1	102.6	4.60	4.7	1200	36.8	27.2	0.74	2.40	45.0	15.3	2.8
	7.0	3.2	7.4	1000	43.0	2.78	33.5	109.8	4.52	5.3	1000	36.1	24.8	0.69	2.22	43.7	16.3	2.4
				1200	44.4	2.78	34.9	104.2	4.67	4.9	1200	37.7	27.4	0.73	2.29	45.5	16.4	2.7
	9.0	5.1	11.8	1000	44.1	2.82	34.5	110.8	4.58	5.4	1000	36.5	25.7	0.71	2.16	43.9	16.9	2.3
				1200	45.6	2.81	36.0	105.2	4.76	5.0	1200	38.1	28.5	0.75	2.25	45.8	17.0	2.5
80	5.0	1.6	3.8	1000	44.1	2.82	34.5	110.8	4.59	5.8	1000	33.7	24.3	0.72	2.53	42.3	13.3	3.2
				1200	45.7	2.80	36.1	105.2	4.79	5.4	1200	35.1	27.1	0.77	2.60	43.9	13.5	3.4
	7.0	3.1	7.1	1000	46.7	2.93	36.7	113.2	4.67	6.0	1000	34.6	24.6	0.71	2.44	43.0	14.2	3.0
				1200	48.2	2.90	38.3	107.2	4.87	5.6	1200	36.0	27.3	0.76	2.51	44.6	14.4	3.3
	9.0	4.9	11.4	1000	48.0	2.97	37.9	114.4	4.74	6.2	1000	35.0	25.3	0.72	2.39	43.2	14.7	2.8
				1200	49.6	2.92	39.7	108.3	4.98	5.7	1200	36.5	28.0	0.77	2.46	44.8	14.8	3.1
90	5.0	1.6	3.7	1000	47.4	2.94	37.3	113.9	4.72	6.6	1000	32.2	24.2	0.75	2.74	41.5	11.8	4.1
				1200	49.0	2.90	39.2	107.8	4.96	6.1	1200	33.3	26.9	0.81	2.81	42.9	11.9	4.3
	7.0	3.0	6.9	1000	50.3	3.07	39.9	116.6	4.80	6.8	1000	33.2	24.6	0.74	2.66	42.2	12.5	3.8
				1200	52.1	3.02	41.8	110.2	5.06	6.3	1200	34.4	27.2	0.79	2.73	43.7	12.6	4.1
	9.0	4.8	11.0	1000	51.9	3.12	41.3	118.1	4.88	7.0	1000	33.5	24.8	0.74	2.62	42.5	12.8	3.5
				1200	53.7	3.04	43.3	111.4	5.18	6.5	1200	34.8	27.4	0.79	2.67	43.9	13.0	3.9
100	5.0	1.5	3.5	Operation not recommended							Operation not recommended							
	7.0	2.9	6.6	1000	31.2	24.0	0.77	2.95	41.3	10.6	4.6	Operation not recommended						
				1200	32.3	26.7	0.83	3.00	42.5	10.8	5.0	Operation not recommended						
	9.0	4.6	10.6	1000	31.6	24.0	0.76	2.90	41.5	10.9	4.3	Operation not recommended						
1200				32.6	26.5	0.81	2.95	42.7	11.1	4.7	Operation not recommended							
110	5.0	1.5	3.4	Operation not recommended							Operation not recommended							
	7.0	2.8	6.4	1000	29.4	23.5	0.80	3.25	40.4	9.0	5.8	Operation not recommended						
				1200	30.2	26.1	0.87	3.27	41.3	9.2	6.2	Operation not recommended						
	9.0	4.4	10.2	1000	29.7	23.2	0.78	3.19	40.5	9.3	5.4	Operation not recommended						
1200				30.5	25.6	0.84	3.22	41.5	9.4	5.9	Operation not recommended							
120	5.0	1.4	3.3	Operation not recommended							Operation not recommended							
	7.0	2.7	6.1	1000	27.3	22.6	0.83	3.57	39.5	7.6	6.9	Operation not recommended						
				1200	27.8	24.5	0.88	3.67	40.3	7.6	7.4	Operation not recommended						
	9.0	4.2	9.8	1000	27.5	22.6	0.82	3.46	39.3	8.0	6.4	Operation not recommended						
1200				28.1	24.5	0.87	3.57	40.3	7.9	7.1	Operation not recommended							

Performance capacities shown in thousands of Mbtu/h.

7/18/14

©2014 The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products.



Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## Performance Data cont.

### 036 - Part Load Dual Capacity with 5-Speed ECM (1000 cfm)

EWT °F	Flow gpm	WPD		HEATING - EAT 70°F							COOLING - EAT 80/67 °F												
		PSI	FT	Airflow cfm	HC Mbtu/h	Power kW	HE Mbtu/h	LAT °F	COP	HWC Mbtu/h	Airflow cfm	TC Mbtu/h	SC Mbtu/h	S/T Ratio	Power kW	HR Mbtu/h	EER	HWC Mbtu/h					
20	4.0	1.4	3.2	Operation not recommended							Operation not recommended												
	6.0	2.8	6.5	Operation not recommended							Operation not recommended												
	8.0	4.8	11.1	850	17.1	1.74	11.1	88.6	2.87	2.9	1000	17.8	1.79	11.7	86.5	2.91	2.6	Operation not recommended					
30	4.0	1.4	3.2	Operation not recommended							Operation not recommended												
	6.0	2.7	6.3	850	18.6	1.72	12.8	90.3	3.17	2.8	850	25.8	16.5	0.64	0.96	29.1	26.8	-					
				1000	19.4	1.77	13.4	88.0	3.22	2.5	1000	26.2	18.1	0.69	1.01	29.7	25.8	-					
				850	19.8	1.76	13.8	91.6	3.29	2.9	850	25.9	16.5	0.64	0.93	29.1	27.7	-					
				1000	20.7	1.81	14.5	89.1	3.34	2.6	1000	26.6	18.1	0.68	0.98	29.9	27.1	-					
40	4.0	1.3	3.1	Operation not recommended							Operation not recommended												
	6.0	2.6	6.1	850	21.8	1.75	15.8	93.7	3.64	2.8	850	27.7	18.9	0.68	1.06	31.4	26.1	-					
				1000	22.6	1.79	16.5	90.9	3.70	2.6	1000	28.3	20.6	0.73	1.11	32.1	25.4	-					
				850	23.0	1.80	16.8	95.0	3.75	2.9	850	28.0	18.9	0.68	1.03	31.5	27.1	-					
				1000	23.8	1.83	17.5	92.0	3.80	2.7	1000	28.6	20.6	0.72	1.08	32.3	26.5	-					
50	4.0	1.3	3.0	850	24.1	1.79	18.0	96.2	3.95	3.0	850	29.0	20.3	0.70	1.19	33.1	24.3	0.9					
				1000	24.8	1.81	18.7	93.0	4.02	2.7	1000	29.8	22.4	0.75	1.22	34.0	24.5	1.0					
	6.0	2.6	5.9	850	24.9	1.79	18.8	97.2	4.09	3.0	850	29.3	20.4	0.70	1.16	33.3	25.2	0.9					
				1000	25.7	1.81	19.5	93.8	4.16	2.8	1000	30.1	22.6	0.75	1.19	34.2	25.4	0.9					
				850	26.1	1.83	19.9	98.4	4.18	3.1	850	29.8	20.9	0.70	1.15	33.7	25.8	0.8					
60	4.0	1.2	2.9	850	27.3	1.83	21.1	99.7	4.38	3.2	850	28.0	19.8	0.71	1.34	32.6	20.9	1.3					
				1000	28.0	1.84	21.7	95.9	4.46	3.0	1000	28.8	21.9	0.76	1.37	33.4	21.0	1.4					
	6.0	2.5	5.7	850	28.4	1.82	22.2	100.9	4.57	3.3	850	28.2	19.9	0.71	1.31	32.7	21.6	1.2					
				1000	29.1	1.83	22.8	96.9	4.65	3.1	1000	29.0	22.0	0.76	1.33	33.6	21.8	1.3					
				850	29.4	1.86	23.0	102.0	4.62	3.4	850	28.7	20.4	0.71	1.30	33.1	22.2	1.1					
70	4.0	1.2	2.8	850	30.5	1.87	24.1	103.2	4.79	3.6	850	26.9	19.3	0.72	1.49	32.0	18.1	1.7					
				1000	31.1	1.87	24.7	98.8	4.88	3.3	1000	27.7	21.4	0.77	1.52	32.9	18.2	1.8					
	6.0	2.4	5.5	850	31.8	1.86	25.5	104.7	5.02	3.7	850	27.2	19.4	0.72	1.45	32.1	18.7	1.6					
				1000	32.4	1.86	26.1	100.0	5.11	3.4	1000	27.9	21.5	0.77	1.48	33.0	18.9	1.7					
				850	32.7	1.90	26.2	105.6	5.04	3.8	850	27.6	19.9	0.72	1.44	32.5	19.2	1.5					
80	4.0	1.2	2.7	850	34.0	1.91	27.4	107.0	5.21	4.1	850	25.7	19.1	0.74	1.69	31.5	15.2	2.3					
				1000	34.4	1.90	27.9	101.9	5.31	3.8	1000	26.4	21.1	0.80	1.72	32.3	15.4	2.5					
	6.0	2.3	5.4	850	35.6	1.90	29.1	108.8	5.49	4.3	850	25.9	19.2	0.74	1.64	31.5	15.8	2.2					
				1000	36.0	1.89	29.6	103.3	5.60	3.9	1000	26.7	21.3	0.80	1.68	32.4	15.9	2.4					
				850	36.1	1.94	29.5	109.3	5.46	4.4	850	26.4	19.7	0.75	1.63	31.9	16.2	2.0					
90	4.0	1.1	2.6	850	37.4	1.96	30.8	110.8	5.60	4.7	850	24.5	18.9	0.77	1.89	30.9	13.0	3.2					
				1000	37.7	1.93	31.1	104.9	5.72	4.4	1000	25.2	20.9	0.83	1.92	31.7	13.1	3.4					
	6.0	2.2	5.2	850	39.4	1.94	32.7	112.9	5.94	4.9	850	24.7	19.0	0.77	1.84	31.0	13.4	3.0					
				1000	39.6	1.91	33.1	106.7	6.07	4.5	1000	25.4	21.0	0.83	1.87	31.8	13.6	3.2					
				850	39.5	1.98	32.8	113.1	5.85	5.0	850	25.1	19.5	0.78	1.82	31.3	13.8	2.8					
100	4.0	1.1	2.5	Operation not recommended							Operation not recommended												
	6.0	2.2	5.0	Operation not recommended							Operation not recommended												
	8.0	3.7	8.5	Operation not recommended							Operation not recommended												
				850	23.0	1.84	0.80	2.08	30.1	11.1	3.8	1000	23.7	20.3	0.86	2.12	30.9	11.2	4.1				
110	4.0	1.0	2.4	Operation not recommended							Operation not recommended												
	6.0	2.1	4.8	Operation not recommended							Operation not recommended												
	8.0	3.5	8.2	Operation not recommended							Operation not recommended												
				850	21.4	17.8	0.83	2.32	29.3	9.2	4.9	1000	22.0	19.7	0.89	2.37	30.1	9.3	5.3				
120	4.0	1.0	2.3	Operation not recommended							Operation not recommended												
	6.0	2.0	4.6	Operation not recommended							Operation not recommended												
	8.0	3.4	7.9	Operation not recommended							Operation not recommended												
				850	19.8	17.9	0.90	2.63	28.8	7.5	6.0	1000	20.1	19.4	0.96	2.70	29.4	7.5	6.4				

Performance capacities shown in thousands of Mbtu/h.

7/18/14

©2014 The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products.

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## Performance Data cont.

### 048 - Full Load Dual Capacity with 5-Speed ECM High Speed (1700 cfm)

EWT °F	Flow gpm	WPD		HEATING - EAT 70°F							COOLING - EAT 80/67 °F							
		PSI	FT	Airflow cfm	HC kBtuh	Power kW	HE kBtuh	LAT °F	COP	HWC kBtuh	Airflow cfm	TC kBtuh	SC kBtuh	S/T Ratio	Power kW	HR kBtuh	EER	HWC kBtuh
20	6.0	1.8	4.1	Operation not recommended							Operation not recommended							
	9.0	4.0	9.2	Operation not recommended							Operation not recommended							
	12.0	7.3	16.8	1400	31.6	2.98	21.4	90.9	3.10	5.6	Operation not recommended							
				1700	32.7	3.03	22.4	87.8	3.17	5.1	Operation not recommended							
30	6.0	1.7	3.9	Operation not recommended							Operation not recommended							
	9.0	3.9	8.9	1400	35.0	3.02	24.7	93.1	3.39	5.7	1400	47.5	30.0	0.63	2.08	54.6	22.8	-
				1700	36.1	3.04	25.7	89.6	3.47	5.3	1700	48.3	32.7	0.68	2.19	55.8	22.0	-
	12.0	7.0	16.3	1400	35.8	3.04	25.5	93.7	3.45	6.0	1400	47.7	30.0	0.63	2.02	54.6	23.6	-
				1700	37.1	3.08	26.6	90.2	3.53	5.4	1700	48.9	32.7	0.67	2.12	56.1	23.1	-
40	6.0	1.7	3.8	Operation not recommended							Operation not recommended							
	9.0	3.7	8.7	1400	39.5	3.13	28.9	96.1	3.71	6.3	1400	50.0	32.6	0.65	2.28	57.8	22.0	-
				1700	40.9	3.13	30.3	92.3	3.84	5.8	1700	51.0	35.6	0.70	2.39	59.1	21.3	-
	12.0	6.8	15.8	1400	40.8	3.15	30.1	97.0	3.80	6.6	1400	50.4	32.6	0.65	2.21	58.0	22.8	-
				1700	42.2	3.17	31.4	93.0	3.91	6.0	1700	51.6	35.6	0.69	2.31	59.4	22.3	-
50	6.0	1.6	3.7	1400	40.9	3.13	30.3	97.1	3.83	6.6	1400	51.2	32.5	0.64	2.92	61.1	17.5	3.0
				1700	42.2	3.13	31.6	93.0	3.96	6.1	1700	52.8	38.4	0.73	3.04	63.2	17.3	3.1
	9.0	3.6	8.4	1400	44.1	3.23	33.1	99.2	4.00	7.0	1400	52.3	32.7	0.63	2.53	60.9	20.7	2.8
				1700	45.8	3.21	34.9	95.0	4.18	6.5	1700	53.9	38.5	0.72	2.65	62.9	20.3	3.0
	12.0	6.6	15.3	1400	45.8	3.25	34.7	100.3	4.13	7.4	1400	52.6	32.7	0.62	2.38	60.7	22.1	2.6
				1700	47.3	3.25	36.2	95.8	4.26	6.7	1700	54.2	38.5	0.71	2.50	62.7	21.7	2.9
60	6.0	1.6	3.6	1400	44.9	3.27	33.7	99.7	4.02	7.4	1400	50.5	32.6	0.64	3.10	61.1	16.3	3.7
				1700	46.5	3.25	35.4	95.3	4.19	6.9	1700	52.1	38.4	0.74	3.24	63.1	16.1	3.8
	9.0	3.5	8.1	1400	48.5	3.35	37.1	102.1	4.25	7.9	1400	51.4	32.8	0.64	2.75	60.7	18.7	3.4
				1700	50.4	3.31	39.1	97.5	4.47	7.3	1700	52.9	38.6	0.73	2.88	62.8	18.4	3.6
	12.0	6.4	14.8	1400	50.6	3.38	39.1	103.5	4.39	8.3	1400	51.9	32.9	0.63	2.61	60.8	19.9	3.2
				1700	52.4	3.34	41.0	98.5	4.60	7.6	1700	53.5	38.7	0.72	2.73	62.8	19.6	3.5
70	6.0	1.5	3.5	1400	48.8	3.41	37.2	102.3	4.20	8.4	1400	49.9	32.6	0.65	3.28	61.1	15.2	4.6
				1700	50.7	3.37	39.2	97.6	4.41	7.8	1700	51.4	38.3	0.75	3.44	63.2	15.0	4.8
	9.0	3.4	7.9	1400	53.0	3.47	41.1	105.0	4.48	8.9	1400	50.4	32.9	0.65	2.97	60.5	16.9	4.2
				1700	55.1	3.41	43.4	100.0	4.73	8.3	1700	52.0	38.7	0.74	3.11	62.6	16.7	4.5
	12.0	6.2	14.3	1400	55.4	3.51	43.4	106.6	4.63	9.4	1400	51.3	33.1	0.65	2.84	61.0	18.0	3.9
				1700	57.5	3.43	45.8	101.3	4.91	8.7	1700	52.8	38.9	0.74	2.95	62.9	17.9	4.3
80	6.0	1.4	3.3	1400	52.7	3.56	40.5	104.8	4.33	9.6	1400	47.9	32.0	0.67	3.50	59.8	13.7	5.8
				1700	54.7	3.50	42.8	99.8	4.58	8.9	1700	49.4	37.6	0.76	3.65	61.9	13.5	6.1
	9.0	3.3	7.6	1400	57.2	3.60	44.9	107.8	4.65	10.2	1400	48.2	32.4	0.67	3.25	59.3	14.8	5.3
				1700	59.5	3.51	47.5	102.4	4.97	9.5	1700	49.6	38.1	0.77	3.38	61.1	14.7	5.7
	12.0	6.0	13.8	1400	60.1	3.64	47.7	109.8	4.84	10.7	1400	49.2	32.6	0.66	3.11	59.9	15.8	5.0
				1700	62.5	3.54	50.4	104.1	5.17	9.9	1700	50.8	38.3	0.76	3.24	61.8	15.7	5.5
90	6.0	1.4	3.2	1400	56.5	3.72	43.9	107.4	4.46	10.9	1400	45.9	31.4	0.68	3.72	58.6	12.3	7.4
				1700	58.7	3.64	46.3	102.0	4.73	10.2	1700	47.4	36.9	0.78	3.87	60.6	12.2	7.8
	9.0	3.2	7.3	1400	61.5	3.74	48.7	110.7	4.82	11.6	1400	45.9	31.8	0.69	3.53	58.0	13.0	6.7
				1700	64.0	3.62	51.7	104.9	5.19	10.8	1700	47.2	37.5	0.79	3.66	59.7	12.9	7.2
	12.0	5.8	13.3	1400	64.9	3.78	52.0	112.9	5.03	12.2	1400	47.2	32.2	0.68	3.38	58.8	14.0	6.3
				1700	67.6	3.66	55.1	106.8	5.41	11.4	1700	48.7	37.8	0.78	3.53	60.7	13.8	7.0
100	6.0	1.3	3.1	Operation not recommended							Operation not recommended							
	9.0	3.1	7.1	Operation not recommended							1400	43.0	31.3	0.73	3.88	56.2	11.1	8.2
				Operation not recommended							1700	44.3	36.9	0.83	4.03	58.1	11.0	8.8
	12.0	5.6	12.9	Operation not recommended							1400	44.6	31.8	0.71	3.74	57.4	11.9	7.8
			Operation not recommended							1700	45.9	37.3	0.81	3.90	59.2	11.8	8.6	
110	6.0	1.3	3.0	Operation not recommended							Operation not recommended							
	9.0	2.9	6.8	Operation not recommended							1400	40.1	30.8	0.77	4.22	54.5	9.5	10.3
				Operation not recommended							1700	41.4	36.3	0.88	4.40	56.4	9.4	11.3
	12.0	5.4	12.4	Operation not recommended							1400	42.0	31.4	0.75	4.09	56.0	10.3	9.9
			Operation not recommended							1700	43.2	36.8	0.85	4.27	57.7	10.1	11.0	
120	6.0	1.2	2.9	Operation not recommended							Operation not recommended							
	9.0	2.8	6.5	Operation not recommended							1400	38.9	31.9	0.82	4.74	55.1	8.2	13.1
				Operation not recommended							1700	39.6	34.7	0.88	4.87	56.2	8.1	14.1
	12.0	5.1	11.9	Operation not recommended							1400	39.3	31.9	0.81	4.59	54.9	8.6	12.1
			Operation not recommended							1700	40.1	34.7	0.86	4.74	56.3	8.5	13.4	

Performance capacities shown in thousands of Mbtu/h.

9/25/14

©2014 The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products.

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## Performance Data cont.

### 048 - Part Load Dual Capacity with 5-Speed ECM (1250 cfm)

EWT °F	Flow gpm	WPD		HEATING - EAT 70°F							COOLING - EAT 80/67 °F							
		PSI	FT	Airflow cfm	HC Mbtu/h	Power kW	HE Mbtu/h	LAT °F	COP	HWC Mbtu/h	Airflow cfm	TC Mbtu/h	SC Mbtu/h	S/T Ratio	Power kW	HR Mbtu/h	EER	HWC Mbtu/h
20	5.0	1.2	2.7	Operation not recommended							Operation not recommended							
	8.0	3.2	7.3	Operation not recommended							Operation not recommended							
	11.0	6.1	14.1	1000	22.6	2.20	15.1	91.0	3.01	4.4	1250	23.5	2.24	15.8	87.4	3.08	4.0	
30	5.0	1.1	2.6	Operation not recommended							Operation not recommended							
	8.0	3.1	7.1	1000	25.6	2.20	18.1	93.7	3.41	4.4	1000	34.9	23.2	0.67	1.07	38.5	32.6	-
				1250	26.4	2.22	18.9	89.6	3.49	4.0	1250	35.4	25.4	0.72	1.13	39.3	31.5	-
				1000	26.3	2.22	18.7	94.3	3.47	4.5	1000	35.1	23.2	0.66	1.04	38.6	33.8	-
				1250	27.2	2.25	19.5	90.2	3.55	4.1	1250	35.9	25.4	0.71	1.09	39.6	33.0	-
40	5.0	1.1	2.5	Operation not recommended							Operation not recommended							
	8.0	3.0	6.9	1000	29.0	2.23	21.4	96.8	3.80	4.6	1000	37.1	25.4	0.68	1.20	41.2	30.9	-
				1250	30.0	2.23	22.4	92.2	3.94	4.2	1250	37.8	27.7	0.73	1.26	42.1	30.0	-
				1000	29.9	2.25	22.3	97.7	3.90	4.7	1000	37.4	25.4	0.68	1.17	41.3	32.1	-
				1250	31.0	2.26	23.2	92.9	4.01	4.3	1250	38.2	27.7	0.73	1.22	42.4	31.3	-
50	5.0	1.1	2.5	1000	30.0	2.19	22.5	97.8	4.01	4.8	1000	38.2	25.4	0.66	1.57	43.6	24.3	1.5
				1250	31.0	2.19	23.5	92.9	4.14	4.5	1250	39.4	29.9	0.76	1.64	45.0	24.0	1.6
	8.0	2.9	6.7	1000	32.3	2.26	24.6	100.0	4.19	5.0	1000	39.1	25.5	0.65	1.36	43.7	28.7	1.4
				1250	33.6	2.25	25.9	94.9	4.37	4.6	1250	40.3	30.1	0.75	1.43	45.1	28.2	1.6
				1000	33.6	2.28	25.8	101.1	4.32	5.1	1000	39.3	25.5	0.65	1.28	43.7	30.6	1.3
			1250	34.7	2.28	26.9	95.7	4.46	4.7	1250	40.5	30.1	0.74	1.35	45.1	30.0	1.5	
60	5.0	1.0	2.4	1000	32.7	2.23	25.0	100.2	4.29	5.3	1000	37.5	25.2	0.67	1.76	43.5	21.3	2.1
				1250	33.8	2.22	26.3	95.1	4.47	4.9	1250	38.7	29.6	0.77	1.84	45.0	21.0	2.3
	8.0	2.8	6.5	1000	35.3	2.29	27.5	102.7	4.53	5.4	1000	38.1	25.3	0.66	1.56	43.5	24.4	2.0
				1250	36.7	2.26	29.0	97.2	4.76	5.0	1250	39.3	29.8	0.76	1.64	44.9	24.0	2.2
				1000	36.8	2.31	29.0	104.1	4.68	5.6	1000	38.6	25.4	0.66	1.49	43.6	26.0	1.9
			1250	38.2	2.28	30.4	98.3	4.90	5.1	1250	39.8	29.9	0.75	1.55	45.0	25.6	2.1	
70	5.0	1.0	2.3	1000	35.3	2.27	27.6	102.7	4.57	5.8	1000	36.8	24.9	0.68	1.95	43.5	18.9	3.0
				1250	36.7	2.24	29.1	97.2	4.80	5.4	1250	38.0	29.3	0.77	2.04	44.9	18.6	3.1
	8.0	2.7	6.2	1000	38.4	2.31	30.5	105.5	4.87	6.0	1000	37.2	25.2	0.68	1.77	43.2	21.1	2.8
				1250	39.9	2.27	32.1	99.5	5.15	5.6	1250	38.4	29.6	0.77	1.85	44.7	20.8	3.0
				1000	40.1	2.33	32.1	107.1	5.04	6.2	1000	37.8	25.3	0.67	1.69	43.6	22.4	2.6
			1250	41.6	2.28	33.8	100.8	5.35	5.7	1250	39.0	29.7	0.76	1.75	45.0	22.2	2.8	
80	5.0	1.0	2.2	1000	38.1	2.31	30.2	105.3	4.84	6.6	1000	35.1	24.4	0.69	2.19	42.6	16.0	4.0
				1250	39.6	2.27	31.9	99.3	5.12	6.1	1250	36.2	28.6	0.79	2.28	44.0	15.9	4.3
	8.0	2.6	6.0	1000	41.4	2.33	33.4	108.3	5.20	6.8	1000	35.3	24.6	0.70	2.03	42.2	17.4	3.7
				1250	43.1	2.27	35.3	101.9	5.55	6.3	1250	36.3	29.0	0.80	2.11	43.6	17.2	4.1
				1000	43.5	2.36	35.4	110.3	5.40	7.0	1000	36.1	24.8	0.69	1.94	42.7	18.6	3.5
			1250	45.2	2.29	37.4	103.5	5.78	6.5	1250	37.2	29.2	0.78	2.03	44.1	18.4	3.9	
90	5.0	0.9	2.2	1000	40.9	2.35	32.9	107.8	5.11	7.5	1000	33.4	23.8	0.71	2.42	41.7	13.8	5.4
				1250	42.5	2.30	34.6	101.5	5.42	7.0	1250	34.5	27.9	0.81	2.52	43.1	13.7	5.7
	8.0	2.5	5.8	1000	44.4	2.36	36.4	111.1	5.52	7.8	1000	33.4	24.1	0.72	2.30	41.2	14.5	5.0
				1250	46.3	2.28	38.5	104.3	5.94	7.2	1250	34.3	28.3	0.83	2.38	42.5	14.4	5.5
				1000	46.9	2.38	38.8	113.4	5.76	8.0	1000	34.3	24.3	0.71	2.20	41.8	15.6	4.7
			1250	48.9	2.31	41.0	106.2	6.20	7.4	1250	35.4	28.6	0.81	2.30	43.2	15.4	5.2	
100	5.0	0.9	2.1	Operation not recommended							Operation not recommended							
	8.0	2.4	5.6	Operation not recommended							1000	31.3	23.3	0.74	2.64	40.3	11.8	6.4
				Operation not recommended							1250	32.2	27.4	0.85	2.74	41.6	11.8	7.0
	11.0	4.7	10.8	Operation not recommended							1000	32.4	23.6	0.73	2.54	41.1	12.8	6.0
			Operation not recommended							1250	33.4	27.7	0.83	2.65	42.4	12.6	6.6	
110	5.0	0.9	2.0	Operation not recommended							Operation not recommended							
	8.0	2.3	5.4	Operation not recommended							1000	29.1	22.4	0.77	2.98	39.3	9.8	8.5
				Operation not recommended							1250	30.1	26.4	0.88	3.10	40.7	9.7	9.2
	11.0	4.5	10.4	Operation not recommended							1000	30.5	22.9	0.75	2.89	40.4	10.6	7.9
			Operation not recommended							1250	31.4	26.8	0.85	3.01	41.7	10.4	8.7	
120	5.0	0.8	1.9	Operation not recommended							Operation not recommended							
	8.0	2.2	5.2	Operation not recommended							1000	28.2	24.0	0.85	3.40	39.7	8.3	11.0
				Operation not recommended							1250	28.7	26.1	0.91	3.49	40.6	8.2	11.7
	11.0	4.3	10.0	Operation not recommended							1000	28.4	24.0	0.85	3.29	39.6	8.6	9.7
			Operation not recommended							1250	29.0	26.1	0.90	3.39	40.6	8.6	10.8	

Performance capacities shown in thousands of Mbtu/h.

7/18/14

©2014 The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products.

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## Performance Data cont.

### 060 - Full Load Dual Capacity with 5-Speed ECM (1800 cfm)

EWT °F	Flow gpm	WPD		HEATING - EAT 70°F							COOLING - EAT 80/67 °F							
		PSI	FT	Airflow cfm	HC Mbtu/h	Power kW	HE Mbtu/h	LAT °F	COP	HWC Mbtu/h	Airflow cfm	TC Mbtu/h	SC Mbtu/h	S/T Ratio	Power kW	HR Mbtu/h	EER	HWC Mbtu/h
20	8.0	2.9	6.8	Operation not recommended							Operation not recommended							
	12.0	6.0	13.8	Operation not recommended							Operation not recommended							
	16.0	10.1	23.3	1500	38.6	3.93	25.2	93.8	2.88	6.1	Operation not recommended							
30	8.0	2.8	6.6	Operation not recommended							Operation not recommended							
	12.0	5.8	13.4	1500	43.9	3.97	30.3	97.1	3.24	6.4	1500	52.9	32.2	0.61	2.69	62.1	19.6	-
				1800	45.1	4.23	30.7	93.2	3.13	5.8	1800	53.7	35.2	0.65	2.84	63.4	18.9	-
				1500	44.5	4.07	30.6	97.5	3.20	6.5	1500	53.2	32.2	0.61	2.61	62.1	20.3	-
				1800	45.6	4.27	31.0	93.5	3.13	5.9	1800	54.4	35.2	0.65	2.74	63.8	19.9	-
40	8.0	2.8	6.4	Operation not recommended							Operation not recommended							
	12.0	5.6	13.0	1500	50.3	4.17	36.1	101.1	3.53	7.0	1500	56.9	35.4	0.62	2.95	67.0	19.3	-
				1800	51.5	4.35	36.6	96.5	3.47	6.4	1800	58.0	38.6	0.67	3.09	68.5	18.8	-
				1500	51.1	4.25	36.6	101.5	3.53	7.2	1500	57.4	35.4	0.62	2.86	67.1	20.1	-
				1800	52.3	4.39	37.3	96.9	3.48	6.6	1800	58.7	38.6	0.66	2.99	68.9	19.6	-
50	8.0	2.7	6.2	1500	53.6	4.28	39.0	103.1	3.67	7.5	1500	60.4	38.0	0.63	3.16	71.2	19.1	3.6
				1800	54.8	4.42	39.7	98.2	3.63	7.0	1800	61.6	41.3	0.67	3.37	73.1	18.3	3.8
	12.0	5.4	12.6	1500	56.7	4.37	41.8	105.0	3.81	7.8	1500	61.0	38.3	0.63	3.10	71.6	19.7	3.3
				1800	57.9	4.48	42.6	99.8	3.79	7.2	1800	62.3	41.7	0.67	3.29	73.5	18.9	3.6
				1500	57.7	4.42	42.6	105.6	3.83	8.0	1500	61.6	38.7	0.63	3.05	72.0	20.2	3.1
60	8.0	2.6	6.0	1500	60.1	4.51	44.7	107.1	3.91	8.5	1500	59.7	38.5	0.65	3.44	71.4	17.4	4.4
				1800	61.4	4.58	45.8	101.6	3.93	7.8	1800	61.2	41.9	0.68	3.66	73.7	16.7	4.6
	12.0	5.3	12.2	1500	62.9	4.58	47.2	108.8	4.02	8.7	1500	60.3	38.9	0.64	3.37	71.8	17.9	4.1
				1800	64.2	4.64	48.4	103.0	4.06	8.0	1800	61.9	42.3	0.68	3.58	74.1	17.3	4.4
				1500	64.2	4.63	48.4	109.6	4.06	9.0	1500	60.9	39.3	0.65	3.31	72.2	18.4	3.8
70	8.0	2.5	5.8	1500	66.6	4.72	50.4	111.1	4.13	9.5	1500	59.0	39.1	0.66	3.71	71.6	15.9	5.4
				1800	68.0	4.74	51.8	105.0	4.20	8.8	1800	60.8	42.5	0.70	3.95	74.3	15.4	5.7
	12.0	5.1	11.8	1500	69.0	4.79	52.6	112.6	4.22	9.8	1500	59.5	39.5	0.66	3.64	72.0	16.4	5.0
				1800	70.6	4.80	54.2	106.3	4.31	9.0	1800	61.5	42.9	0.70	3.87	74.7	15.9	5.4
				1500	70.7	4.85	54.2	113.7	4.28	10.1	1500	60.1	39.8	0.66	3.58	72.3	16.8	4.7
80	8.0	2.4	5.6	1500	72.9	4.97	55.9	115.0	4.30	10.6	1500	56.9	38.8	0.68	4.03	70.6	14.1	7.0
				1800	74.6	4.94	57.7	108.4	4.42	9.8	1800	59.0	42.1	0.71	4.29	73.6	13.7	7.4
	12.0	4.9	11.4	1500	74.6	5.03	57.5	116.1	4.35	11.0	1500	57.5	39.1	0.68	3.95	70.9	14.5	6.5
				1800	76.4	4.98	59.4	109.3	4.50	10.1	1800	59.6	42.5	0.71	4.20	73.9	14.2	7.0
				1500	76.9	5.09	59.5	117.5	4.43	11.3	1500	58.0	39.5	0.68	3.88	71.3	14.9	6.0
90	8.0	2.3	5.4	1500	79.2	5.21	61.4	118.9	4.46	11.9	1500	54.7	38.4	0.70	4.35	69.5	12.6	9.1
				1800	81.1	5.13	63.6	111.7	4.63	11.0	1800	57.1	41.7	0.73	4.63	72.9	12.3	9.7
	12.0	4.8	11.0	1500	80.3	5.27	62.3	119.5	4.47	12.3	1500	55.3	38.7	0.70	4.26	69.9	13.0	8.5
				1800	82.3	5.16	64.7	112.3	4.68	11.4	1800	57.7	42.1	0.73	4.54	73.1	12.7	9.2
				1500	83.0	5.33	64.8	121.2	4.56	12.6	1500	55.9	39.2	0.70	4.19	70.2	13.3	7.9
100	8.0	2.2	5.2	Operation not recommended							Operation not recommended							
	12.0	4.6	10.6	Operation not recommended							Operation not recommended							
	16.0	7.7	17.8	Operation not recommended							Operation not recommended							
				1500	51.7	37.3	0.72	4.70	67.8	11.0	10.2	Operation not recommended						
				1800	54.2	40.5	0.75	5.00	71.3	10.8	11.0	Operation not recommended						
110	8.0	2.2	5.0	Operation not recommended							Operation not recommended							
	12.0	4.4	10.2	Operation not recommended							Operation not recommended							
	16.0	7.4	17.2	Operation not recommended							Operation not recommended							
				1500	48.1	35.8	0.74	5.13	65.6	9.4	13.1	Operation not recommended						
				1800	50.7	38.9	0.77	5.47	69.4	9.3	14.2	Operation not recommended						
120	8.0	2.1	4.8	Operation not recommended							Operation not recommended							
	12.0	4.2	9.8	Operation not recommended							Operation not recommended							
	16.0	7.1	16.5	Operation not recommended							Operation not recommended							
				1500	46.1	35.1	0.76	5.96	66.4	7.7	15.6	Operation not recommended						
				1800	47.0	38.2	0.81	6.11	67.8	7.7	16.3	Operation not recommended						

Performance capacities shown in thousands of Mbtu/h.

7/18/14

©2014 The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products.

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## Performance Data cont.

### 060 - Part Load Dual Capacity with 5-Speed ECM (1500 cfm)

EWT °F	Flow gpm	WPD		HEATING - EAT 70°F							COOLING - EAT 80/67 °F							
		PSI	FT	Airflow cfm	HC Mbtu/h	Power kW	HE Mbtu/h	LAT °F	COP	HWC Mbtu/h	Airflow cfm	TC Mbtu/h	SC Mbtu/h	S/T Ratio	Power kW	HR Mbtu/h	EER	HWC Mbtu/h
20	6.0	1.8	4.1	Operation not recommended							Operation not recommended							
	10.0	4.3	10.0	Operation not recommended							Operation not recommended							
	14.0	7.8	18.1	1250	27.7	3.01	17.5	90.5	2.70	5.3	Operation not recommended							
				1500	28.7	3.05	18.3	87.7	2.76	4.8	Operation not recommended							
30	6.0	1.7	3.9	Operation not recommended							Operation not recommended							
	10.0	4.2	9.7	1250	30.9	3.05	20.5	92.9	2.97	5.1	1250	39.9	23.5	0.59	1.57	45.2	25.4	-
				1500	32.0	3.09	21.5	89.8	3.04	4.7	1500	40.5	25.7	0.63	1.65	46.2	24.5	-
	14.0	7.6	17.6	1250	32.0	3.05	21.6	93.7	3.08	5.3	1250	40.1	23.5	0.59	1.52	45.3	26.3	-
				1500	33.1	3.09	22.6	90.4	3.14	4.8	1500	41.1	25.7	0.63	1.60	46.5	25.7	-
	40	6.0	1.7	3.8	Operation not recommended							Operation not recommended						
10.0		4.1	9.4	1250	36.2	3.11	25.6	96.8	3.41	5.4	1250	44.0	27.8	0.63	1.73	49.9	25.5	-
				1500	37.2	3.12	26.6	93.0	3.49	5.0	1500	44.8	30.3	0.68	1.81	51.0	24.8	-
14.0		7.4	17.1	1250	37.4	3.12	26.7	97.7	3.51	5.6	1250	44.4	27.8	0.63	1.67	50.1	26.5	-
				1500	38.4	3.13	27.7	93.7	3.59	5.1	1500	45.4	30.3	0.67	1.75	51.3	25.9	-
50		6.0	1.6	3.7	1250	40.8	3.12	30.2	100.2	3.84	5.7	1250	48.0	30.5	0.64	1.92	54.5	25.0
	1500				41.9	3.12	31.3	95.9	3.94	5.3	1500	49.4	34.7	0.70	2.03	56.3	24.4	2.0
	10.0	4.0	9.1	1250	41.5	3.18	30.6	100.7	3.83	5.9	1250	48.1	30.8	0.64	1.85	54.4	26.0	1.7
				1500	42.4	3.16	31.6	96.2	3.94	5.4	1500	49.5	34.9	0.71	1.94	56.1	25.5	1.9
	14.0	7.2	16.5	1250	42.7	3.20	31.8	101.6	3.92	6.0	1250	48.2	30.8	0.64	1.82	54.4	26.6	1.6
				1500	43.7	3.18	32.8	97.0	4.03	5.5	1500	49.6	34.9	0.70	1.90	56.1	26.1	1.8
60	6.0	1.6	3.6	1250	45.2	3.18	34.3	103.5	4.16	6.2	1250	46.4	30.4	0.66	2.16	53.8	21.5	2.6
				1500	46.2	3.16	35.4	98.5	4.29	5.7	1500	47.8	34.4	0.72	2.26	55.6	21.2	2.8
	10.0	3.8	8.8	1250	46.6	3.24	35.6	104.5	4.22	6.4	1250	46.6	30.7	0.66	2.09	53.8	22.3	2.5
				1500	47.3	3.19	36.5	99.2	4.35	5.9	1500	48.0	34.7	0.72	2.18	55.5	22.0	2.7
	14.0	6.9	16.0	1250	47.7	3.27	36.6	105.3	4.28	6.6	1250	46.8	30.8	0.66	2.05	53.8	22.9	2.3
				1500	48.5	3.22	37.5	99.9	4.41	6.1	1500	48.2	34.8	0.72	2.14	55.5	22.5	2.5
70	6.0	1.5	3.5	1250	49.6	3.25	38.5	106.7	4.48	6.9	1250	44.9	30.4	0.68	2.40	53.1	18.7	3.7
				1500	50.4	3.19	39.5	101.1	4.63	6.4	1500	46.3	34.0	0.74	2.50	54.8	18.5	3.9
	10.0	3.7	8.6	1250	51.7	3.30	40.4	108.3	4.59	7.1	1250	45.2	30.6	0.68	2.33	53.1	19.4	3.4
				1500	52.3	3.23	41.2	102.3	4.74	6.5	1500	46.6	34.4	0.74	2.43	54.8	19.2	3.7
	14.0	6.7	15.5	1250	52.7	3.34	41.3	109.0	4.63	7.3	1250	45.4	30.8	0.68	2.28	53.2	19.9	3.2
				1500	53.2	3.27	42.1	102.9	4.78	6.7	1500	46.8	34.6	0.74	2.38	55.0	19.7	3.5
80	6.0	1.4	3.3	1250	53.8	3.29	42.6	109.8	4.79	7.7	1250	42.8	30.0	0.70	2.72	52.0	15.7	5.0
				1500	54.3	3.22	43.3	103.5	4.94	7.1	1500	44.1	33.5	0.76	2.81	53.7	15.7	5.3
	10.0	3.6	8.3	1250	56.8	3.34	45.4	112.1	4.98	7.9	1250	43.1	30.3	0.70	2.65	52.2	16.3	4.7
				1500	57.1	3.25	46.0	105.2	5.16	7.3	1500	44.4	34.0	0.76	2.75	53.8	16.1	5.1
	14.0	6.5	15.0	1250	57.5	3.39	45.9	112.6	4.97	8.1	1250	43.4	30.5	0.70	2.61	52.3	16.6	4.4
				1500	57.7	3.29	46.5	105.6	5.14	7.5	1500	44.8	34.2	0.76	2.70	54.0	16.6	4.8
90	6.0	1.4	3.2	1250	58.0	3.33	46.6	113.0	5.10	8.6	1250	40.6	29.7	0.73	3.04	51.0	13.3	6.9
				1500	58.1	3.25	47.1	105.9	5.25	8.0	1500	41.8	33.0	0.79	3.13	52.5	13.4	7.3
	10.0	3.4	8.0	1250	61.9	3.39	50.4	115.9	5.36	8.9	1250	41.1	30.0	0.73	2.98	51.2	13.8	6.4
				1500	61.9	3.26	50.8	108.2	5.56	8.2	1500	42.3	33.5	0.79	3.08	52.8	13.7	7.0
	14.0	6.2	14.4	1250	62.3	3.44	50.6	116.2	5.31	9.1	1250	41.4	30.3	0.73	2.94	51.4	14.1	6.0
				1500	62.2	3.32	50.9	108.4	5.50	8.5	1500	42.7	33.7	0.79	3.03	53.1	14.1	6.6
100	6.0	1.3	3.1	Operation not recommended							Operation not recommended							
	10.0	3.3	7.7	1250	37.9	29.2	0.77	3.39	49.4	11.2	8.0	Operation not recommended						
				1500	39.0	32.3	0.83	3.48	50.9	11.2	8.7	Operation not recommended						
	14.0	6.0	13.9	1250	38.3	29.6	0.77	3.35	49.7	11.4	7.5	Operation not recommended						
1500				39.5	32.7	0.83	3.43	51.2	11.5	8.3	Operation not recommended							
110	6.0	1.3	3.0	Operation not recommended							Operation not recommended							
	10.0	3.2	7.4	1250	34.7	28.4	0.82	3.81	47.7	9.1	10.4	Operation not recommended						
				1500	35.8	31.2	0.87	3.89	49.0	9.2	11.2	Operation not recommended						
	14.0	5.8	13.4	1250	35.1	28.9	0.82	3.75	47.9	9.4	9.6	Operation not recommended						
				1500	36.2	31.7	0.87	3.83	49.3	9.5	10.7	Operation not recommended						
120	6.0	1.2	2.9	Operation not recommended							Operation not recommended							
	10.0	3.1	7.1	1250	34.2	28.0	0.82	4.31	48.9	7.9	13.6	Operation not recommended						
				1500	34.8	30.4	0.87	4.43	49.9	7.9	14.5	Operation not recommended						
	14.0	5.6	12.9	1250	34.5	28.0	0.81	4.17	48.7	8.3	12.5	Operation not recommended						
1500				35.2	30.4	0.86	4.31	49.9	8.2	13.8	Operation not recommended							

Performance capacities shown in thousands of Mbtu/h.

7/18/14

©2014 The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products.

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## Performance Data cont.

### 072 - Full Load Dual Capacity with 5-Speed ECM High Speed (2300 cfm)

EWT °F	Flow gpm	WPD		HEATING - EAT 70°F							COOLING - EAT 80/67 °F																
		PSI	FT	Airflow cfm	HC kBtuh	Power kW	HE kBtuh	LAT °F	COP	HWC kBtuh	Airflow cfm	TC kBtuh	SC kBtuh	S/T Ratio	Power kW	HR kBtuh	EER	HWC kBtuh									
20	12.0	4.0	9.1	Operation not recommended							Operation not recommended																
	15.0	5.9	13.5	Operation not recommended							Operation not recommended																
	18.0	8.1	18.7	1850	49.3	4.60	33.6	94.7	3.14	8.7	2300	51.1	4.90	34.4	90.6	3.06	7.9	Operation not recommended									
30	12.0	3.8	8.9	Operation not recommended							Operation not recommended																
	15.0	5.7	13.1	1850	55.5	4.74	39.3	97.8	3.43	9.0	2300	57.5	5.04	40.2	93.1	3.34	8.2	1850	57.3	35.2	0.61	3.14	68.0	18.2	-		
	18.0	7.8	18.1	1850	56.0	4.78	39.6	98.0	3.43	9.2	2300	58.0	5.09	40.7	93.4	3.34	8.4	1850	57.6	35.2	0.61	3.05	68.0	18.9	-		
				2300	58.0	5.09	40.7	93.4	3.34	8.4	2300	59.0	38.5	0.65	3.20	69.9	18.4	-									
40	12.0	3.7	8.6	Operation not recommended							Operation not recommended																
	15.0	5.5	12.7	1850	63.0	4.97	46.0	101.5	3.71	9.7	2300	65.1	5.21	47.4	96.2	3.67	8.9	1850	63.0	39.9	0.63	3.47	74.8	18.2	-		
	18.0	7.6	17.6	1850	63.9	5.03	46.7	102.0	3.72	10.0	2300	66.1	5.26	48.1	96.6	3.68	9.1	1850	63.5	39.9	0.63	3.36	75.0	18.9	-		
				2300	66.1	5.26	48.1	96.6	3.68	9.1	2300	64.9	43.6	0.67	3.52	76.9	18.5	-									
50	12.0	3.6	8.3	1850	66.8	5.10	49.3	103.4	3.83	10.4	2300	69.0	5.28	51.0	97.8	3.83	9.6	1850	68.1	43.8	0.64	3.74	80.8	18.2	4.0		
				1850	70.5	5.20	52.8	105.3	3.97	10.7	2300	72.8	5.37	54.5	99.3	3.98	9.9	1850	68.8	44.3	0.64	3.66	81.3	18.8	3.8		
	15.0	5.3	12.3	1850	71.8	5.26	53.8	105.9	4.00	11.1	2300	74.1	5.42	55.6	99.8	4.01	10.1	1850	70.1	48.2	0.69	3.90	83.4	18.0	4.1		
				1850	71.8	5.26	53.8	105.9	4.00	11.1	2300	74.1	5.42	55.6	99.8	4.01	10.1	1850	69.5	45.2	0.65	3.60	81.8	19.3	3.5		
	18.0	7.4	17.0	1850	74.1	5.42	55.6	99.8	4.01	10.1	2300	70.9	48.6	0.69	3.84	83.9	18.5	3.9	1850	69.5	45.2	0.65	3.60	81.8	19.3	3.5	
				2300	74.1	5.42	55.6	99.8	4.01	10.1	2300	70.9	48.6	0.69	3.84	83.9	18.5	3.9	1850	70.9	48.6	0.69	3.84	83.9	18.5	3.9	
60	12.0	3.5	8.1	1850	74.9	5.40	56.5	107.5	4.07	11.7	2300	77.3	5.50	58.5	101.1	4.12	10.8	1850	69.2	46.3	0.67	4.08	83.1	16.9	5.1		
				1850	78.2	5.49	59.4	109.1	4.17	12.0	2300	80.7	5.58	61.7	102.5	4.24	11.1	1850	70.6	50.1	0.71	4.34	85.4	16.3	5.4		
	15.0	5.2	11.9	1850	79.9	5.56	61.0	110.0	4.22	12.4	2300	82.6	5.63	63.3	103.2	4.29	11.4	1850	69.9	46.8	0.67	4.00	83.5	17.5	4.7		
				1850	79.9	5.56	61.0	110.0	4.22	12.4	2300	82.6	5.63	63.3	103.2	4.29	11.4	2300	71.3	50.6	0.71	4.25	85.8	16.8	5.1		
	18.0	7.1	16.5	1850	82.9	5.68	63.5	111.5	4.28	13.1	2300	85.6	5.72	66.0	104.4	4.38	12.1	1850	70.6	47.5	0.67	3.93	84.0	18.0	4.4		
				1850	82.9	5.68	63.5	111.5	4.28	13.1	2300	85.6	5.72	66.0	104.4	4.38	12.1	2300	72.0	51.1	0.71	4.19	86.3	17.2	4.9		
70	12.0	3.4	7.8	1850	82.9	5.68	63.5	111.5	4.28	13.1	2300	85.6	5.72	66.0	104.4	4.38	12.1	1850	70.3	48.8	0.69	4.43	85.4	15.9	6.5		
				1850	85.9	5.77	66.2	113.0	4.36	13.5	2300	88.6	5.78	68.8	105.7	4.49	12.4	2300	71.7	52.5	0.73	4.70	87.8	15.2	6.9		
	15.0	5.0	11.6	1850	88.1	5.85	68.1	114.1	4.42	13.9	2300	91.0	5.85	71.0	106.6	4.56	12.8	1850	71.0	49.3	0.69	4.34	85.8	16.4	6.0		
				1850	88.1	5.85	68.1	114.1	4.42	13.9	2300	91.0	5.85	71.0	106.6	4.56	12.8	2300	72.4	53.0	0.73	4.60	88.1	15.7	6.5		
	18.0	6.9	15.9	1850	90.8	6.03	70.3	115.5	4.42	14.8	2300	93.8	6.03	73.4	107.8	4.59	13.7	1850	71.7	49.8	0.69	4.26	86.3	16.9	5.6		
				1850	90.8	6.03	70.3	115.5	4.42	14.8	2300	93.8	6.03	73.4	107.8	4.59	13.7	2300	73.2	53.6	0.73	4.54	88.7	16.1	6.2		
80	12.0	3.3	7.5	1850	90.8	6.03	70.3	115.5	4.42	14.8	2300	93.8	6.03	73.4	107.8	4.59	13.7	1850	67.2	47.7	0.71	4.85	83.7	13.8	8.2		
				1850	93.0	6.11	72.1	116.5	4.46	15.2	2300	96.0	6.03	75.4	108.6	4.66	14.1	2300	68.5	51.6	0.75	5.16	86.2	13.3	8.7		
	15.0	4.8	11.2	1850	95.8	6.19	74.7	118.0	4.54	15.7	2300	99.0	6.09	78.2	109.9	4.76	14.5	1850	67.8	48.2	0.71	4.75	84.0	14.3	7.6		
				1850	95.8	6.19	74.7	118.0	4.54	15.7	2300	99.0	6.09	78.2	109.9	4.76	14.5	2300	69.2	52.0	0.75	5.06	86.4	13.7	8.3		
	18.0	6.7	15.4	1850	99.0	6.09	78.2	109.9	4.76	14.5	2300	103.5	6.53	81.3	121.8	4.65	17.7	1850	68.5	48.9	0.71	4.67	84.5	14.7	7.1		
				1850	99.0	6.09	78.2	109.9	4.76	14.5	2300	103.5	6.53	81.3	121.8	4.65	17.7	2300	69.9	52.6	0.75	4.97	86.9	14.1	7.8		
90	12.0	3.1	7.3	1850	98.7	6.37	77.0	119.4	4.54	16.7	2300	102.0	6.24	80.7	111.1	4.79	15.4	1850	64.0	46.6	0.73	5.28	82.0	12.1	10.5		
				1850	100.1	6.44	78.1	120.1	4.55	17.2	2300	103.4	6.27	81.9	111.6	4.83	15.9	2300	65.4	50.6	0.77	5.62	84.5	11.6	11.1		
	15.0	4.7	10.8	1850	103.5	6.53	81.3	121.8	4.65	17.7	2300	107.0	6.34	85.3	113.1	4.94	16.4	1850	64.6	47.0	0.73	5.17	82.3	12.5	9.8		
				1850	103.5	6.53	81.3	121.8	4.65	17.7	2300	107.0	6.34	85.3	113.1	4.94	16.4	2300	66.0	51.0	0.77	5.51	84.8	12.0	10.6		
	18.0	6.4	14.9	1850	107.0	6.34	85.3	113.1	4.94	16.4	2300	107.0	6.34	85.3	113.1	4.94	16.4	1850	65.4	48.0	0.73	5.08	82.7	12.9	9.1		
				1850	107.0	6.34	85.3	113.1	4.94	16.4	2300	107.0	6.34	85.3	113.1	4.94	16.4	2300	66.7	51.6	0.77	5.41	85.2	12.3	10.1		
100	12.0	3.0	7.0	Operation not recommended							Operation not recommended																
	15.0	4.5	10.4	Operation not recommended							Operation not recommended																
	18.0	6.2	14.3	Operation not recommended							Operation not recommended																
110	12.0	2.9	6.7	Operation not recommended							Operation not recommended																
	15.0	4.3	10.0	Operation not recommended							Operation not recommended																
	18.0	6.0	13.8	1850	58.0	43.8	0.75	6.29	79.5	9.2	15.6	2300	59.2	47.1	0.79	6.69	82.1	8.9	16.9	1850	58.7	44.2	0.75	6.18	79.8	9.5	14.4
				2300	59.9	47.5	0.79	6.57	82.3	9.1	16.0	2300	59.9	47.5	0.79	6.57	82.3	9.1	16.0	2300	59.9	47.5	0.79	6.57	82.3	9.1	16.0
120	12.0	2.8	6.5	Operation not recommended							Operation not recommended																
	15.0	4.2	9.6	Operation not recommended							Operation not recommended																
	18.0	5.7	13.2	1850	54.0	42.2	0.78	7.25	78.7	7.4	18.5	2300	55.0	45.8	0.83	7.44	80.3	7.4	20.0	1850	54.5	42.2	0.78	7.01	78.4	7.8	17.1
				2300	55.6	45.8	0.82	7.24	80.3	7.7	19.0	2300	55.6	45.8	0.82	7.24	80.3	7.7	19.0	2300	55.6	45.8	0.82	7.24	80.3	7.7	19.0

Performance capacities shown in thousands of Btuh.

7/18/14

©2014 The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products.

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## Performance Data cont.

### 072 - Part Load Dual Capacity with 5-Speed ECM (1850 cfm)

EWT °F	Flow gpm	WPD		HEATING - EAT 70°F							COOLING - EAT 80/67 °F							
		PSI	FT	Airflow cfm	HC Mbtu/h	Power kW	HE Mbtu/h	LAT °F	COP	HWC Mbtu/h	Airflow cfm	TC Mbtu/h	SC Mbtu/h	S/T Ratio	Power kW	HR Mbtu/h	EER	HWC Mbtu/h
20	10.0	2.9	6.8	Operation not recommended							Operation not recommended							
	13.0	4.6	10.5	Operation not recommended							Operation not recommended							
	16.0	6.6	15.1	1650	36.0	3.74	23.3	90.2	2.82	7.0	Operation not recommended							
				1850	37.8	3.79	24.8	88.9	2.92	6.3	Operation not recommended							
30	10.0	2.8	6.6	Operation not recommended							Operation not recommended							
	13.0	4.4	10.2	1650	39.7	3.81	26.7	92.3	3.05	6.9	1650	47.9	29.6	0.62	1.96	54.6	24.5	-
				1850	41.6	3.86	28.5	90.8	3.16	6.4	1850	48.7	32.4	0.66	2.06	55.8	23.6	-
	16.0	6.4	14.7	1650	41.4	3.81	28.4	93.2	3.19	7.1	1650	48.2	29.6	0.61	1.90	54.7	25.3	-
				1850	43.4	3.86	30.2	91.7	3.30	6.5	1850	49.4	32.4	0.66	2.00	56.2	24.7	-
	40	10.0	2.8	6.4	Operation not recommended							Operation not recommended						
13.0		4.3	9.9	1650	46.1	3.92	32.8	95.9	3.45	7.3	1650	52.8	34.3	0.65	2.17	60.2	24.3	-
				1850	48.2	3.93	34.8	94.1	3.59	6.7	1850	53.8	37.4	0.70	2.28	61.5	23.6	-
16.0		6.2	14.3	1650	47.8	3.93	34.4	96.8	3.56	7.5	1650	53.2	34.3	0.64	2.11	60.4	25.2	-
				1850	49.9	3.94	36.4	95.0	3.71	6.8	1850	54.4	37.4	0.69	2.21	61.9	24.6	-
50		10.0	2.7	6.2	1650	51.8	3.98	38.2	99.1	3.81	7.7	1650	57.3	37.1	0.65	2.44	65.7	23.5
	1850				54.1	3.94	40.7	97.1	4.03	7.1	1850	59.1	42.1	0.71	2.56	67.9	23.1	2.4
	13.0	4.2	9.6	1650	52.5	4.02	38.8	99.5	3.83	7.9	1650	57.5	37.4	0.65	2.35	65.5	24.4	2.1
				1850	54.7	4.00	41.0	97.4	4.00	7.3	1850	59.3	42.5	0.72	2.48	67.7	23.9	2.3
	16.0	6.0	13.8	1650	54.1	4.04	40.3	100.3	3.92	8.2	1650	57.6	37.4	0.65	2.29	65.5	25.1	2.0
				1850	56.4	4.02	42.7	98.2	4.11	7.5	1850	59.4	42.5	0.72	2.42	67.6	24.6	2.2
60	10.0	2.6	6.0	1650	57.7	4.11	43.7	102.4	4.12	8.5	1650	56.4	37.6	0.67	2.75	65.8	20.5	3.2
				1850	60.1	4.02	46.4	100.1	4.38	7.8	1850	58.1	42.5	0.73	2.88	67.9	20.2	3.4
	13.0	4.0	9.3	1650	59.3	4.15	45.2	103.3	4.19	8.7	1650	56.6	38.0	0.67	2.66	65.7	21.3	3.0
				1850	61.7	4.07	47.8	100.9	4.44	8.0	1850	58.3	43.0	0.74	2.79	67.8	20.9	3.3
	16.0	5.8	13.4	1650	60.7	4.19	46.4	104.1	4.24	9.0	1650	56.9	38.1	0.67	2.61	65.8	21.8	2.8
				1850	63.1	4.12	49.1	101.6	4.49	8.3	1850	58.6	43.1	0.73	2.72	67.9	21.5	3.1
70	10.0	2.5	5.8	1650	63.7	4.23	49.2	105.7	4.41	9.4	1650	55.5	38.2	0.69	3.07	65.9	18.1	4.5
				1850	66.3	4.11	52.2	103.2	4.73	8.7	1850	57.1	43.0	0.75	3.19	68.0	17.9	4.8
	13.0	3.9	9.0	1650	66.1	4.27	51.5	107.1	4.53	9.7	1650	55.8	38.6	0.69	2.97	65.9	18.8	4.2
				1850	68.7	4.15	54.5	104.4	4.85	8.9	1850	57.4	43.5	0.76	3.09	67.9	18.6	4.6
	16.0	5.6	12.9	1650	67.3	4.34	52.5	107.8	4.55	10.0	1650	56.1	38.8	0.69	2.93	66.1	19.1	3.9
				1850	69.9	4.21	55.5	105.0	4.86	9.2	1850	57.9	43.6	0.75	3.03	68.2	19.1	4.3
80	10.0	2.4	5.6	1650	69.3	4.32	54.6	108.9	4.70	10.6	1650	51.8	37.1	0.72	3.49	63.7	14.8	6.1
				1850	71.9	4.17	57.7	106.0	5.06	9.8	1850	48.5	41.5	0.86	3.59	60.8	13.5	5.9
	13.0	3.8	8.7	1650	73.0	4.37	58.1	111.0	4.89	10.9	1650	47.5	37.5	0.79	3.40	59.1	14.0	5.2
				1850	75.6	4.20	61.3	107.8	5.28	10.1	1850	48.9	42.0	0.86	3.50	60.9	14.0	5.6
	16.0	5.4	12.5	1650	73.8	4.43	58.7	111.4	4.88	11.3	1650	47.9	37.8	0.79	3.35	59.3	14.3	4.8
				1850	76.4	4.27	61.8	108.2	5.24	10.4	1850	54.3	42.3	0.78	3.44	66.0	15.8	5.8
90	10.0	2.3	5.4	1650	75.0	4.41	60.0	112.1	4.99	11.9	1650	48.1	36.1	0.75	3.91	61.5	12.3	8.2
				1850	77.5	4.23	63.1	108.8	5.38	11.0	1850	49.6	40.1	0.81	3.99	63.3	12.4	8.7
	13.0	3.6	8.4	1650	79.9	4.47	64.6	114.8	5.24	12.3	1650	48.6	36.5	0.75	3.83	61.7	12.7	7.6
				1850	82.5	4.25	68.1	111.3	5.70	11.4	1850	50.1	40.6	0.81	3.91	63.5	12.8	8.3
	16.0	5.2	12.1	1650	80.4	4.53	64.9	115.1	5.20	12.7	1650	49.1	36.8	0.75	3.77	62.0	13.0	7.1
				1850	82.9	4.33	68.1	111.5	5.61	11.7	1850	50.7	40.9	0.81	3.85	63.8	13.2	7.9
100	10.0	2.2	5.2	Operation not recommended							Operation not recommended							
	13.0	3.5	8.1	1650	45.5	35.7	0.79	4.36	60.4	10.4	9.7	Operation not recommended						
				1850	47.0	39.6	0.84	4.41	62.1	10.6	10.5	Operation not recommended						
	16.0	5.0	11.6	1650	46.1	36.2	0.78	4.30	60.8	10.7	9.0	Operation not recommended						
1850				47.5	40.0	0.84	4.35	62.4	10.9	10.0	Operation not recommended							
110	10.0	2.2	5.0	Operation not recommended							Operation not recommended							
	13.0	3.4	7.8	1650	42.4	35.0	0.83	4.90	59.1	8.7	12.9	Operation not recommended						
				1850	43.9	38.6	0.88	4.92	60.6	8.9	13.9	Operation not recommended						
	16.0	4.8	11.2	1650	43.1	35.6	0.82	4.83	59.6	8.9	11.9	Operation not recommended						
1850				44.4	39.2	0.88	4.85	61.0	9.1	13.3	Operation not recommended							
120	10.0	2.1	4.8	Operation not recommended							Operation not recommended							
	13.0	3.2	7.5	1650	39.1	34.2	0.87	5.49	57.9	7.1	15.7	Operation not recommended						
				1850	39.9	37.1	0.93	5.63	59.1	7.1	16.7	Operation not recommended						
	16.0	4.6	10.7	1650	39.5	34.2	0.87	5.31	57.6	7.4	14.4	Operation not recommended						
1850				40.3	37.1	0.92	5.48	59.0	7.4	15.9	Operation not recommended							

Performance capacities shown in thousands of Mbtu/h.

7/18/14

©2014 The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products.

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_


Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



# Wiring Schematics

## Aurora BASE with 5-Speed ECM

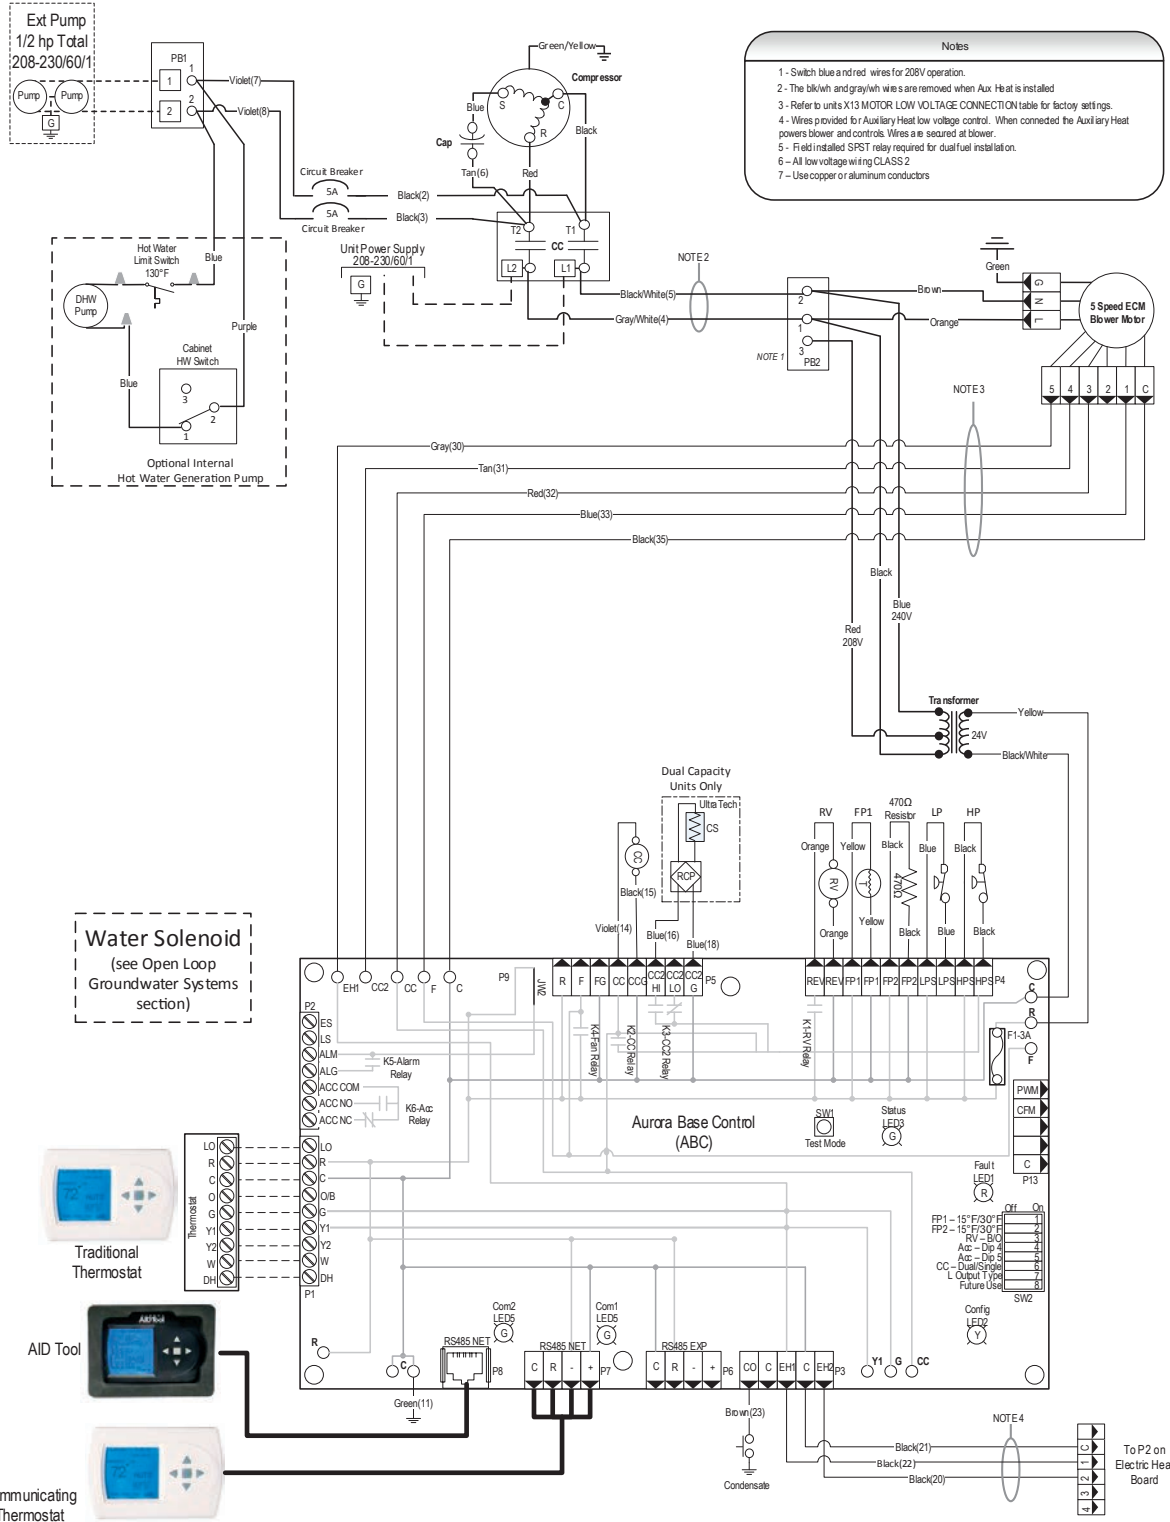

©2014 The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products.




Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_  
 Engineer: \_\_\_\_\_  
 Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



# Wiring Schematics cont.

## Aurora BASE with 5-Speed ECM cont.


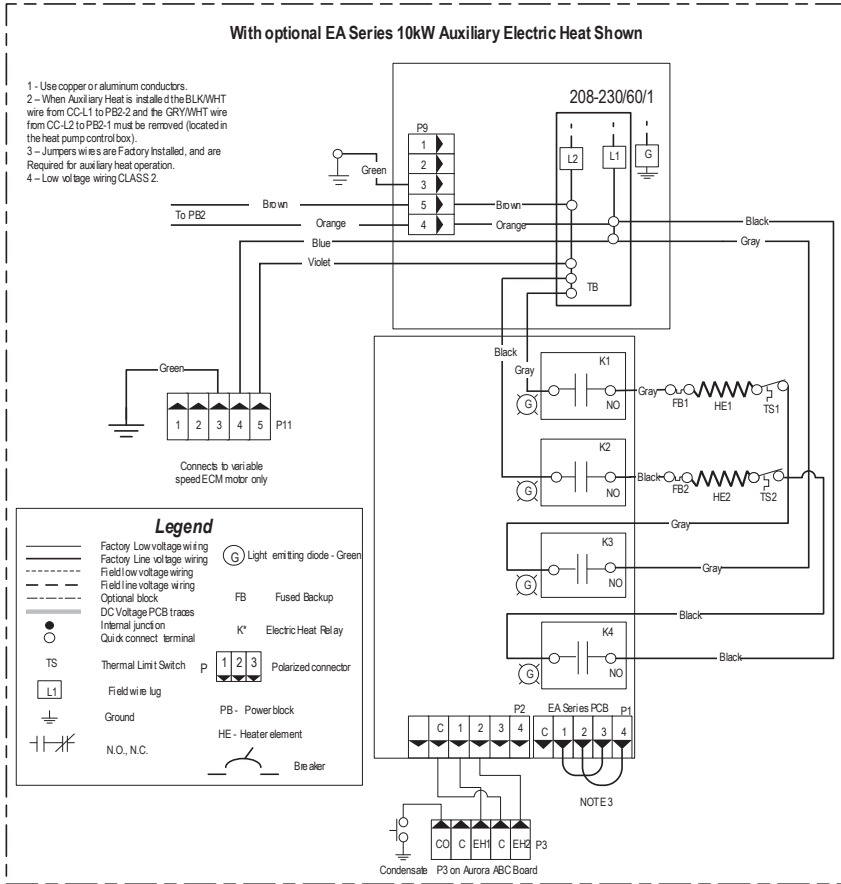


Aurora LED Flash Codes			
Slow Flash	1 second on and 1 second off	Normal Mode	ON
Fast Flash	100 milliseconds on and 100 milliseconds off	Control is Non-Functional	OFF
Flash Code	100 milliseconds on and 400 milliseconds off with a 2 second pause before repeating	Test Mode	Slow Flash
Random Start Delay (Alternative Colors)	Configuration LED (LED2, Yellow)	Lockout Active	Fast Flash
Status LED (LED1, Green)	No Software Override	Dehumidification Mode	Flash Code 2
Configuration LED (LED2, Yellow)	Fast Flash	Future Use	Flash Code 3
Fault LED (LED3, Red)	Fast Flash	Future Use	Flash Code 4
Normal Mode	OFF	Future Use	Flash Code 5
Input Fault Lockout	Flash Code 1	Future Use	Flash Code 6
High Pressure Lockout	Flash Code 2	Future Use	Flash Code 7
Low Pressure Lockout	Flash Code 3	Future Use	Flash Code 8
Future Use	Flash Code 4	Future Use	Flash Code 9
Freeze Detect on - FP1	Flash Code 5	Future Use	Flash Code 10
Reserved	Flash Code 6	Future Use	Flash Code 11
Condensate Overflow Lockout	Flash Code 7	Future Use	
Over/Under Voltage Shutdown	Flash Code 8	Future Use	
Future Use	Flash Code 9	Future Use	
Future Use	Flash Code 10	Future Use	
FP1 Sensor Error	Flash Code 11		

ABC SW2 Accessory Relay		
DESCRIPTION	SW2-4	SW2-5
Cycle with Blower	ON	ON
Cycle with Compressor	OFF	OFF
Water Valve Slow Opening	ON	OFF
Cycle with Comm. T-stat Hum Cmd	OFF	ON

Aurora Timing Events			
Event	Normal Mode	Test Mode	
Random Start Delay	5 to 80 seconds	1 second	
Compressor On Delay	5 seconds	< 1 second	
Compressor Minimum On Time	2 minutes	5 seconds	
Compressor Short Cycle Delay	4 minutes	15 seconds	
Blower Off Delay	30 seconds	2 seconds	
Fault Recognition Delay - High Pressure	Less than 1 second	Less than 1 second	
Start-Up Bypass - Low Pressure	2 minutes	30 seconds	
Fault Recognition Delay - Low Pressure	30 seconds	30 seconds	
Start-Up Bypass - Low Water Coil Limit	2 minutes	30 seconds	
Fault Recognition Delay - Low Water Coil Limit	30 seconds	30 seconds	
Fault Recognition Delay - Condensate Overflow	30 seconds	30 seconds	
Thermostat Call Recognition Time	2 seconds	2 seconds	
Comfort Alert Recognition Time	90 seconds	90 seconds	
Auxiliary Heat Start-up Delay	5 minutes	20 seconds	
Emergency Heat Start-up Delay	2 minutes	7.5 seconds	
Water Valve Slow Open Delay	90 seconds	90 seconds	

5 SPEED ECM MOTOR LOW VOLTAGE CONNECTIONS					
Model	TAP-1	TAP-2	TAP-3	TAP-4	TAP-5
024	BLUE	RED		TAN	GRAY
036	BLUE	RED		TAN	GRAY
048	BLUE	RED		TAN	GRAY
060	BLUE	RED		TAN	GRAY
072	BLUE	RED		TAN	GRAY

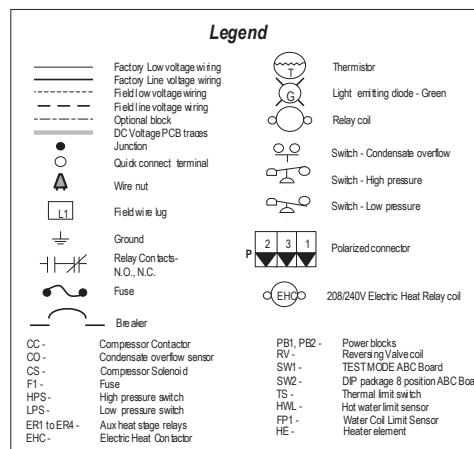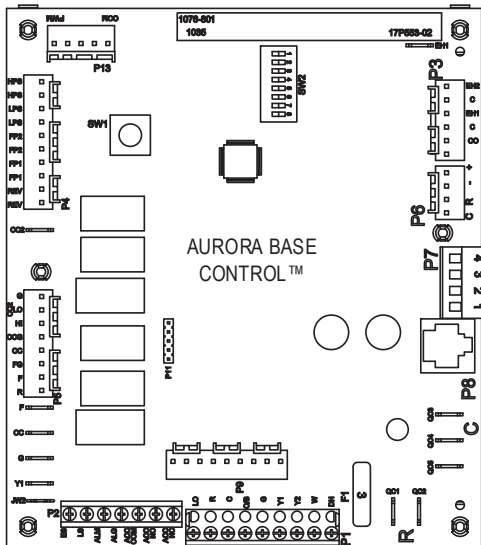

©2014 The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products.

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_


Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



# Wiring Schematics cont.

## Aurora BASE with 5 Speed ECM and IntelliStart

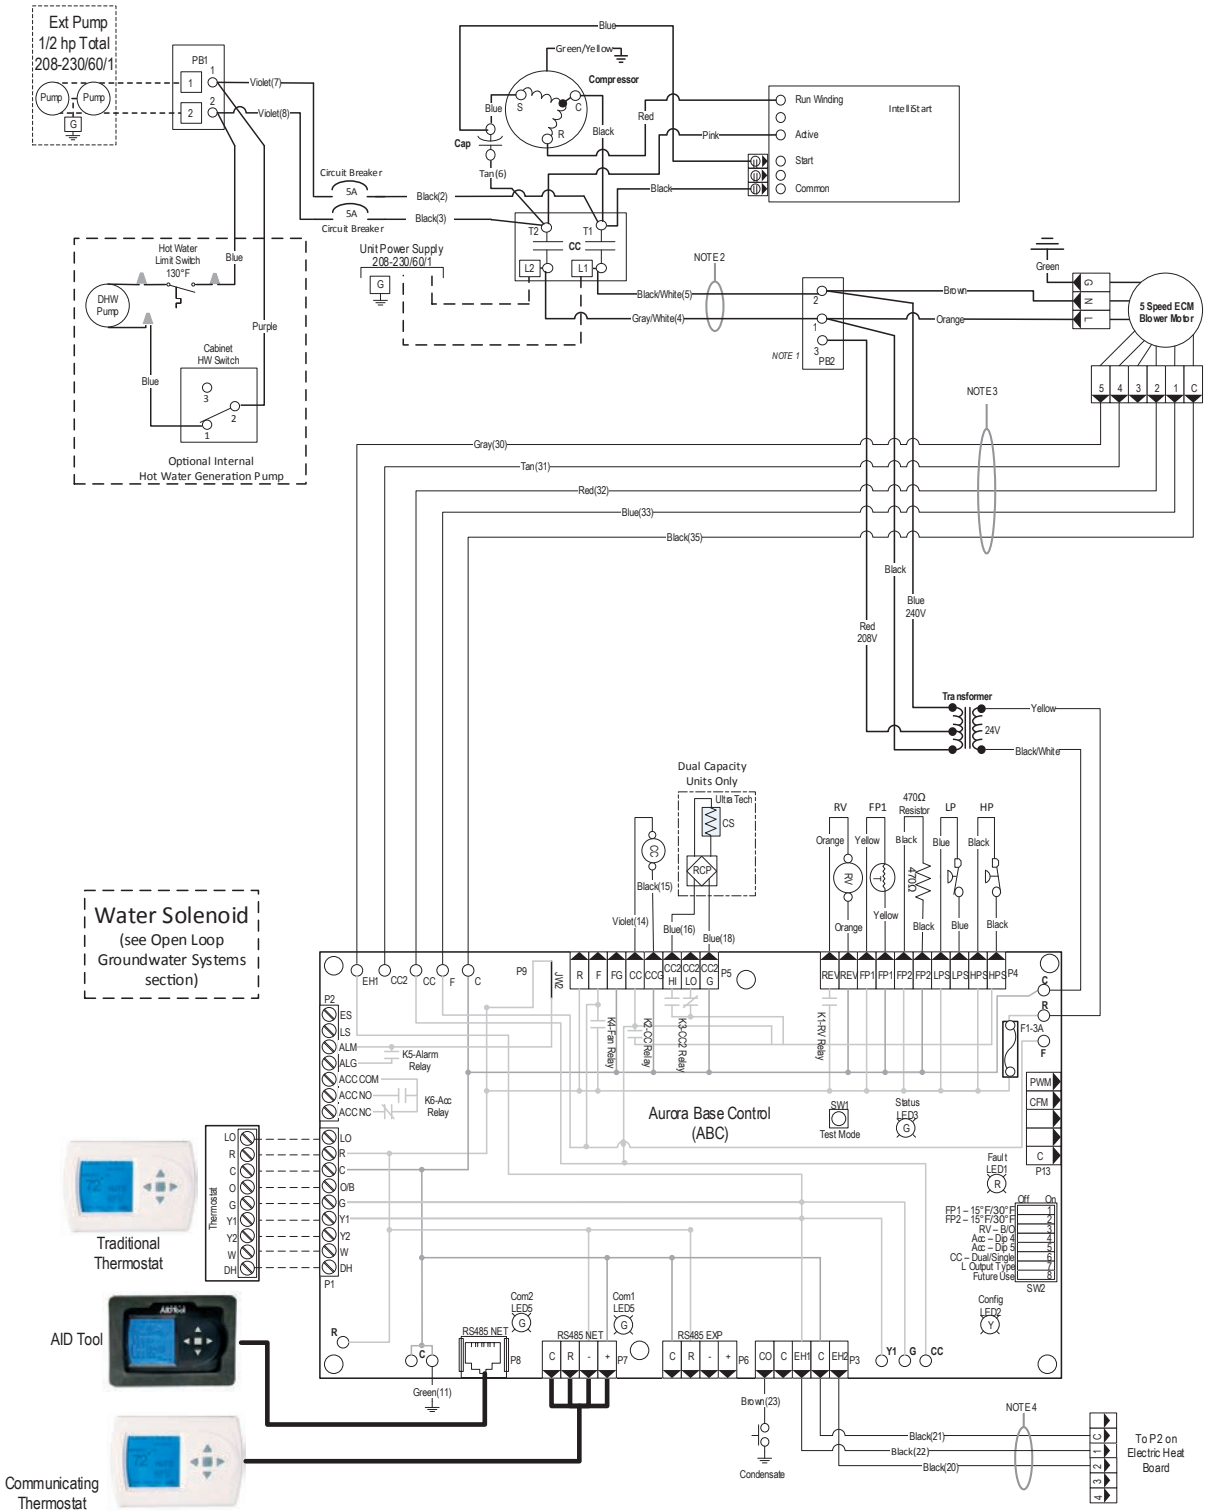


©2014 The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products.

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_  
 Engineer: \_\_\_\_\_  
 Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



# Wiring Schematics cont.

## Aurora BASE with 5 Speed ECM and IntelliStart

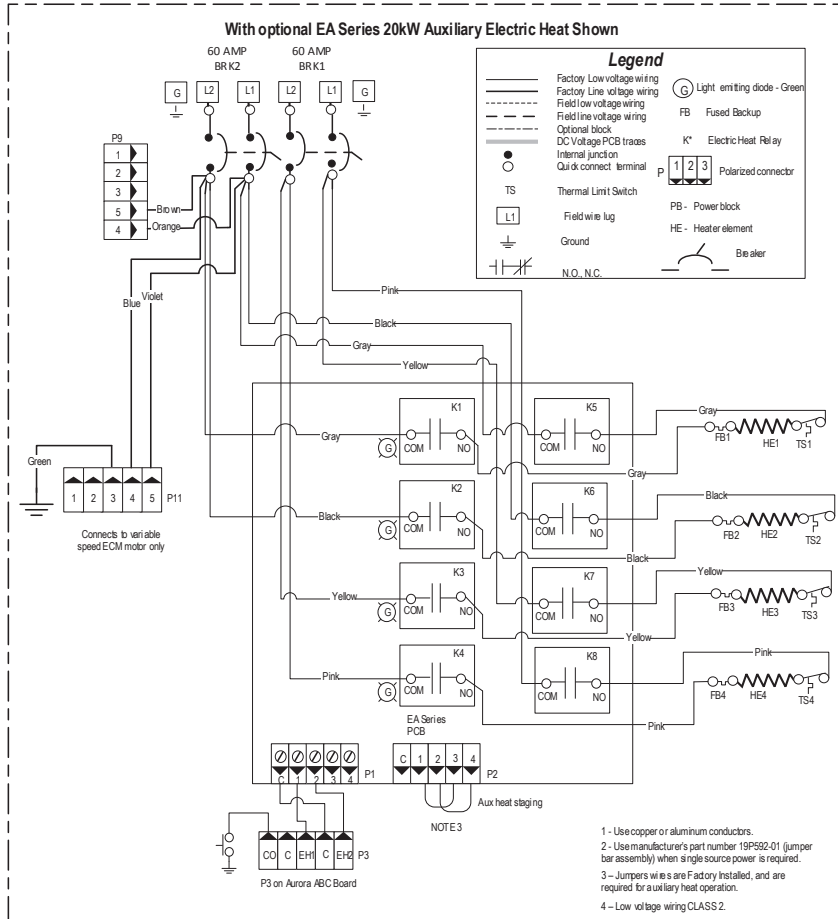

**Aurora LED Flash Codes**

Flash Code	Normal Mode	Test Mode
Slow Flash	1 second on and 1 second off	OFF
Fast Flash	100 milliseconds on and 100 milliseconds off	OFF
Random Start Delay (Alternating Colors)	100 milliseconds on and 400 milliseconds off with a 2 second pause before repeating	OFF
Configuration LED (LED2, Yellow)	Flash Code 1	Flash Code 2
Status LED (LED1, Green)	Flash Code 3	Flash Code 4
Configuration LED (LED3, Red)	Flash Code 5	Flash Code 6
Fault LED (LED1, Red)	Flash Code 7	Flash Code 8
Status LED (LED3, Green)	Flash Code 9	Flash Code 10
Normal Mode	OFF	ON
Input Fault Lockout	Flash Code 1	Control is Non-Functional
High Pressure Lockout	Flash Code 2	Test Mode
Low Pressure Lockout	Flash Code 3	Lockout Active
Future Use	Flash Code 4	Dehumidification Mode
Freeze Detect on - FP1	Flash Code 5	Future Use
Reserved	Flash Code 6	Future Use
Condensate Overflow Lockout	Flash Code 7	Load Shed
Over/Under Voltage Shutdown	Flash Code 8	ESD
Future Use	Flash Code 9	Future Use
Future Use	Flash Code 10	Future Use
FP1 Sensor Error	Flash Code 11	

**ABC SW2 Accessory Relay**

DESCRIPTION	SW2-4	SW2-5
Cycle with Blower	ON	ON
Cycle with Compressor	OFF	OFF
Water Valve Slow Opening	ON	OFF
Cycle with Comm. 1-stat Hum Cmd	OFF	ON

**Aurora Timing Events**



Event	Normal Mode	Test Mode
Random Start Delay	5 to 80 seconds	1 second
Compressor On Delay	5 seconds	< 1 second
Compressor Minimum On Time	2 minutes	5 seconds
Compressor Short Cycle Delay	4 minutes	15 seconds
Blower Off Delay	30 seconds	2 seconds
Fault Recognition Delay - High Pressure	Less than 1 second	Less than 1 second
Start-Up Bypass - Low Pressure	2 minutes	30 seconds
Fault Recognition Delay - Low Pressure	30 seconds	30 seconds
Start-Up Bypass - Low Water Coil Limit	2 minutes	30 seconds
Fault Recognition Delay - Low Water Coil Limit	30 seconds	30 seconds
Fault Recognition Delay - Condensate Over/ov	30 seconds	30 seconds
Thermostat Call Recognition Time	2 seconds	2 seconds
Comfort Alert Response Time	90 seconds	90 seconds
Auxiliary Heat Staging Delay	5 minutes	20 seconds
Emergency Heat Staging Delay	2 minutes	7.5 seconds
Water Valve Slow Open Delay	90 seconds	90 seconds

**5 SPEED ECM MOTOR LOW VOLTAGE CONNECTIONS**

Model	TAP-1	TAP-2	TAP-3	TAP-4	TAP-5
024	BLUE	RED		TAN	GRAY
036	BLUE	RED		TAN	GRAY
048	BLUE	RED		TAN	GRAY
060	BLUE	RED		TAN	GRAY
072	BLUE	RED		TAN	GRAY

**Notes**

- 1 - Switch blue and red wires for 208V operation.
- 2 - The blue and gray wires are removed when Aux Heat is installed.
- 3 - Refer to unit's MOTOR LOW VOLTAGE CONNECTION table for factory settings.
- 4 - Wires provided for Auxiliary Heat low voltage control. When connected the Auxiliary Heat powers blower and controls. Wires are secured at blower.
- 5 - Field installed SPST relay required for dual fuel installation.
- 6 - All low voltage wiring CLASS 2.
- 7 - Use copper or aluminum conductors.

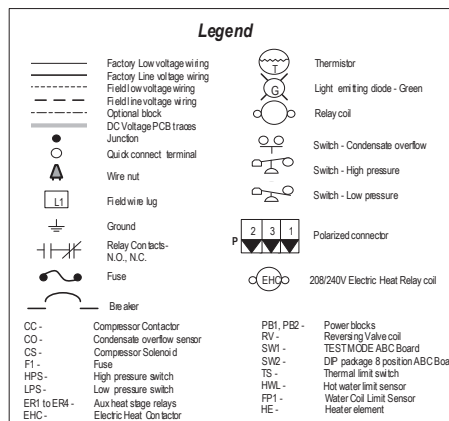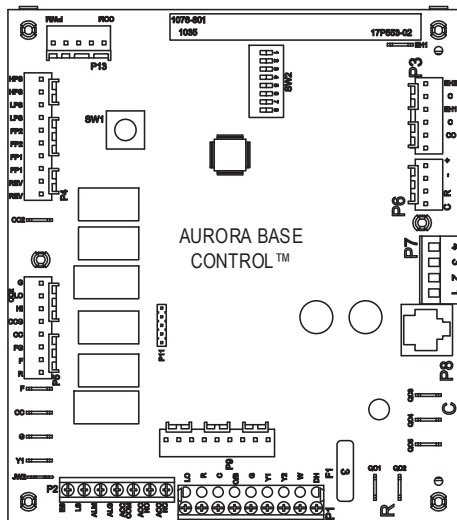

©2014 The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products.

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## Engineering Guide Specifications

### General

Furnish and install Water Source Heat Pumps, as indicated on the plans. Equipment shall be completely assembled, piped and internally wired. Capacities and characteristics as listed in the schedule and the specifications that follow. The reverse cycle heating/cooling units shall be either suspended type with horizontal air inlet and discharge or floor mounted type with horizontal air inlet and vertical upflow air discharge. Units shall be AHRI/ISO 13256-1 certified and listed by a nationally recognized safety-testing laboratory or agency, such as ETL Testing Laboratory. Each unit shall be computer run-tested at the factory with conditioned water and operation verified to catalog data. Each unit shall be mounted on a pallet and shipped in a corrugated box or stretch-wrapped. The units shall be designed to operate with entering liquid temperature between 20°F and 120°F [-6.7°C and 48.9°C].

### Casing and Cabinet

The cabinet shall be fabricated from heavy-gauge galvanized steel and finished with corrosion-resistant powder coating. This corrosion protection system shall meet the stringent 1000 hour salt spray test per ASTM B117. The interior shall be insulated with 1/2-inch thick, multi-density, cleanable aluminum foil coated glass fiber with edges sealed or tucked under flanges to prevent the introduction of glass fibers into the discharge air. Standard cabinet panel insulation must meet NFPA 90A requirements, air erosion and mold growth limits of UL-181, stringent fungal resistance test per ASTM-C1071 and ASTM G21, and shall meet zero level bacteria growth per ASTM G22. Unit insulation must meet these stringent requirements or unit(s) will not be accepted.

One (horizontal) to two (vertical) blower and three compressor compartment access panels shall be 'lift-out' removable with supply and return ductwork in place. The front access panel shall be lift-out to provide easy access to the electrical/compressor section. The internal component layout shall provide for service access from the front side for restricted installations.

A duct collar shall be provided on the supply air opening. A duct flange shall be provided for the return air opening. Standard size 1 in. [2.5 cm] MERV 8 pleated filters shall be optional with filter rack or filter rails. The upflow vertical units shall have a removable insulated divider panel between the air handling section and the compressor section to minimize the transmission of compressor noise and to permit operational service testing without air bypass. Vertical units shall be supplied with left or right horizontal air inlet and top air discharge. Horizontal units shall be supplied with left or right air inlet and side or end air discharge. The compressor shall be double isolation mounted using selected durometer grommets to provide vibration free compressor mounting.

The drain pan shall be of plastic construction to inhibit corrosion and bacterial growth. Drain outlet shall be located on pan as to allow complete and unobstructed drainage of condensate. The unit as standard will be supplied with solid-state electronic condensate overflow protection. Mechanical float switches WILL NOT be accepted. Vertical units shall be furnished with a PVC slip condensate drain connection and an internal factory installed condensate trap.

### Refrigerant Circuit

All units shall contain a sealed refrigerant circuit including a hermetic motor-compressor, discharge line muffler, bidirectional thermostatic expansion valve, all aluminum finned tube air-to-refrigerant heat exchanger, reversing valve, coaxial tube water-to-refrigerant heat exchanger, optional hot water generator coil, and service ports.

Compressors shall be high-efficiency dual capacity scroll type designed for heat pump duty and mounted on vibration isolators. Compressor motors shall be single-phase PSC with overload protection. The coil shall be sized for low-face velocity and constructed of lanced aluminum fins bonded to aluminum tubes in a staggered pattern not less than three rows deep for enhanced performance. Models shall include discharge mufflers to help quiet compressor discharge gas pulsations. Refrigerant to air heat exchangers shall utilize aluminum tube construction rated to withstand 600 psig (4135 kPa) refrigerant working pressure.

The coaxial water-to-refrigerant heat exchanger shall be designed for low water pressure drop and constructed of a convoluted copper (cupronickel option) inner tube and a steel outer tube. Refrigerant to water heat exchangers shall be of copper inner water tube and steel refrigerant outer tube design, rated to withstand 600 psig (4135 kPa) working refrigerant pressure and 450 psig (3101 kPa) working water pressure. The thermostatic expansion valve shall provide proper superheat over the entire liquid temperature range with minimal "hunting." The valve shall operate bidirectionally without the use of check valves.

All units shall have the source coaxial tube refrigerant-to-water heat exchanger and the optional hot water generator coil shall be coated with ThermaShield. Refrigerant suction lines shall be insulated to prevent condensation at low liquid temperatures.

### Blower Motor and Assembly

The blower shall be a direct drive centrifugal type with a dynamically balanced wheel. The housing and wheel shall be designed for quiet low outlet velocity operation. The blower housing shall be removable from the unit without disconnecting the supply air ductwork for servicing of the blower motor. The blower motor shall be a 5-speed ECM.

The ECM blower motor shall be soft starting, and shall provide 5 TAP settings. The blower motor shall be isolated from the housing by rubber grommets. The motor shall be permanently lubricated and have thermostatic overload protection. 5-speed ECM motors shall be long-life ball bearing type.

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## Engineering Guide Specifications cont.

### Electrical

A control box shall be located within the unit compressor compartment and shall contain a 75VA transformer, 24 volt activated, 2 pole compressor contactor, circuit breakers for protecting loop pumps, terminal block for thermostat wiring, and solid-state controller for complete unit operation. Electromechanical operation WILL NOT be accepted. Units shall be name-plated for use with time delay fuses or HACR circuit breakers. Unit controls shall be 24 volt and provide heating or cooling as required by the remote thermostat/sensor. An Aurora, a microprocessor-based controller, interfaces with a multi-stage electronic thermostat to monitor and control unit operation shall be provided. The control shall provide operational sequencing, blower speed control, high and low pressure switch monitoring, freeze detection, condensate overflow sensing, auxiliary heat staging, lockout mode control, and loop pump control, LED status and fault indicators, fault memory, field selectable options, and accessory output. The Lockout signal output shall have a pulsed option so that DDC systems can read specific lockout conditions from the control.

A detachable terminal block with screw terminals will be provided for field control wiring. All units shall have knockouts for entrance of low and line voltage wiring. The blower motor and control box shall be harness plug wired for easy removal.

An optional Aurora Interface Diagnostic (AID) Tool shall communicate with the Aurora control allowing quick and easy access to setup, monitoring, and troubleshooting of any Aurora control. The device shall include the features of fault description and history, manual operation capability, sensor readings, timings, and other diagnostic tools.

Optional IntelliStart® (compressor Soft Starter) shall be factory installed for use in applications that require low starting amps, reduced compressor start-up noise, off-grid, and improved start-up behavior. IntelliStart shall reduce normal starting current by up to 60%.

### Piping

Supply and return water connections shall be 1 in. [25.4 mm] FPT brass swivel fittings, which provide a union and eliminate the need for pipe wrenches and sealants when making field connections. The optional hot water generator shall have sweat type connections. All water piping shall be insulated to prevent condensation at low liquid temperatures, on the vertical units, the condensate connection shall be a 3/4 in. [19.1 mm] PVC socket with internally-trapped hose that can be routed to front or side locations.

### Hanger Kit

#### (field-installed horizontal units only)

The hanger kit shall consist of galvanized steel brackets, bolts, lock washers, and isolators and shall be designed to fasten to the unit bottom panel for suspension from 3/8-inch threaded rods. Unit sizes 024-036 shall include four brackets. Unit sizes 048-072 shall include six brackets.

### Options and Accessories

#### Cupronickel Heat Exchanger

An optional cupronickel water-to-refrigerant heat exchanger shall be provided.

#### Hot Water Generator

An optional ThermaShield coated heat reclaiming hot water generator coil of vented double-wall copper construction suitable for potable water shall be provided. The coil and hot water circulating pump shall be factory mounted inside the unit with integral electronic high limit temperature monitoring and external on/off switch.

#### Thermostat (field-installed)

A multi-stage auto-changeover electronic digital thermostat shall be provided. The thermostat shall offer three heating and two cooling stages with precise temperature control. An OFF-HEAT-AUTO-COOL-EMERG system switch, OFF-AUTO blower switch, and indicating LEDs shall be provided. The thermostat shall display in °F or °C. The thermostat shall be either a communicating type or a traditional 24 VAC type.

#### Communicating Thermostat (field-installed)

A communicating auto-changeover electronic digital thermostat shall be provided. The thermostat shall offer variable speed heating and cooling staging with precise temperature control. An OFF-HEAT-AUTO-COOL-EMERG system switch, OFF-AUTO blower switch, and indicating display shall be provided. The thermostat shall display in °F or °C.

#### Communicating Color Touchscreen Thermostat (field-installed)

A color touchscreen communicating auto-changeover electronic digital thermostat shall be provided. The thermostat shall offer variable speed heating and cooling staging with precise temperature control. An OFF-HEAT-AUTO-COOL-EMERG system switch, OFF-AUTO blower switch, and indicating display shall be provided. The thermostat shall display in °F or °C.

#### Electronic Air Cleaner (field-installed)

A 1 in. [25 mm] electronic air cleaner, cleanable 97% efficiency at 0.3 microns and larger, shall be provided in lieu of the standard throwaway filter. The initial pressure drop across the filter shall not exceed 0.2 in. w.g. at 300 fpm force velocity.

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## Engineering Guide Specifications cont.

---

### **Electrostatic Air Cleaner (field-installed)**

A 1 in. [25 mm] electrostatic air cleaner, cleanable 90% efficiency, shall be provided in lieu of the standard throwaway filter. The initial pressure drop across the filter shall not exceed 0.15 in. w.g. at 300 fpm face velocity.

### **AlpinePure Drain Pan Treatment (field-installed)**

Provides dependable, sustained time-release protection from slime build-up and foul smelling odors in the drain pan. Also adds a light, pleasant scent to the air.

### **Earth Loop Flow Center (field-installed)**

A self-contained module shall provide all liquid flow, fill and connection requirements for ground source closed loop systems up to 20 gpm. The pumps shall be wired to a power block located in the nearest unit. The heat pump units shall contain low voltage pump linking control so that two units may share one flow center.

### **Auxiliary Heater (field-installed)**

An electric resistance heater shall provide supplemental and/or emergency heating capability. Vertical units shall have the control panel and resistance heater coil assembly mounted internally. For horizontal units, the control panel shall be mounted internally while the resistance heater coil assembly shall be mounted externally. A low voltage plug shall be provided in each unit for quick auxiliary heat connection. The heater shall operate in sequenced stages as controlled by the unit's microprocessor. The heater shall feed line voltage power to the unit blower and transformer to provide emergency heat capability in the event of an open compressor circuit breaker.

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## Revision Guide

---

Pages:	Description:	Date:	By:
2	Updated Nomenclature	01 June 2021	MA
Misc.	Updated AHRI Data, Misc. Updates	01 Feb 2018	JM
Misc.	Updated Wiring Schematics, Physical Data	14 Dec 2016	MA
ALL	Literature Creation	18 Sept 2014	MA